

inge<sup>®</sup> product Series  
dizzer<sup>®</sup> L Series Modules for Horizontal Systems

## Process Requirements



## Legal Notice

### Product

dizzer<sup>®</sup> L Series UF Modules for Horizontal Systems and corresponding parts and components for operation.

### Manufacturer

inge GmbH  
Flurstraße 27  
86926 Greifenberg  
Germany

Duplication and archiving in any form whatsoever – including of excerpts – is only permitted with the written consent of the manufacturer.

All brand and company names in this document are registered trademarks of the corresponding companies.

### Change Policy

The manufacturer reserves the right to change this process requirements or any part thereof at any time in the interest of continuous product improvement.

The company/party responsible for process and design of the system described in this manual should obtain the current inge<sup>®</sup> process requirements at regular intervals:

- Download at: <https://www.dupont.com/brands/inge.html>
- By e-mail to [inge@dupont.com](mailto:inge@dupont.com)
- By telephone under +49 8192 997-700

### Change History


Version	Version date	Author	History
V 0	06/2020	RW/GS	Initial creation
V 1.0	08/2020	RW/GS	Minor adjustment
V 2	03/2021	GS	Minor adjustment

## Table of Contents

<b>1</b>	<b>About these Process Requirements .....</b>	<b>5</b>
1.1	Objective of these Process Requirements .....	5
1.2	Target Groups.....	6
1.3	Symbols in this Process Requirements .....	6
1.3.1	Symbols .....	6
1.3.2	Notes on Instructions and Rules.....	6
<b>2</b>	<b>The inge<sup>®</sup> Product Family .....</b>	<b>7</b>
2.1	Multibore <sup>®</sup> Membrane Technology .....	7
<b>3</b>	<b>Membrane Operating Modes .....</b>	<b>9</b>
3.1	Filtration .....	9
3.2	Backwash .....	10
3.3	Operating Cycles .....	12
3.3.1	Repetitive Operation .....	12
<b>4</b>	<b>Feed Water Quality and Pretreatment.....</b>	<b>13</b>
4.1	Maximum Feed Concentration and Goals of Pretreatment.....	13
4.2	Microflocculation .....	14
4.3	Performing Microflocculation .....	15
4.4	Continuous Chlorination in UF feed water.....	18
<b>5</b>	<b>Chemically Enhanced Backwash (CEB).....</b>	<b>19</b>
5.1	General Overview .....	19
5.2	Types of CEB.....	21
5.3	How a CEB is Performed.....	22
<b>6</b>	<b>Chemical Clean In Place (CIP) .....</b>	<b>24</b>
6.1	General Overview .....	24
6.2	Establishing CIP Recirculation .....	26
6.3	How a CIP is Performed .....	27
6.3.1	Preparing the Chemical Solution for a CIP .....	27
6.3.2	Preparing for a CIP Process .....	27
6.3.3	Recirculation and Soak Time.....	27
6.4	Preparing to Rinse out the Rack/System.....	28
6.5	Rinsing out the Rack/System .....	28
<b>7</b>	<b>Using Chemicals for CEB/CIP .....</b>	<b>29</b>
7.1	Differences between CIP und CEB .....	29
7.2	Permissible Chemicals and Operating Conditions .....	29

<b>8</b>	<b>UF System Functionality .....</b>	<b>33</b>
<b>9</b>	<b>System Commissioning .....</b>	<b>36</b>
9.1	General Overview .....	36
9.2	Functional Testing .....	37
9.3	Module Preservation.....	38
9.4	Venting and Rinsing.....	38
9.4.1	Venting the System.....	38
9.4.2	Rinsing the System.....	39
<b>10</b>	<b>Disinfecting the System .....</b>	<b>40</b>
<b>11</b>	<b>Integrity Testing .....</b>	<b>42</b>
11.1	General Overview .....	42
11.2	Compressed Air Specification .....	43
11.3	Testing Frequency .....	43
11.4	How to Perform a Pressure Hold Test.....	44
<b>12</b>	<b>Further Functionality requirements on Operating inge® dizzer® L Series Modules .....</b>	<b>48</b>
12.1	Avoiding Membrane-Damaging Particles and Substances .....	48
12.2	Preventing Chemically Irreversible Fouling .....	49
12.3	Permitted Conditions of Operation, Rinsing, Cleaning and Disinfection .....	50
<b>13</b>	<b>System Shutdowns.....</b>	<b>52</b>
<b>14</b>	<b>Documentation of Operating Conditions .....</b>	<b>53</b>
<b>15</b>	<b>Technical Documentation .....</b>	<b>54</b>
15.1	Other Applicable Documents .....	54
	<b>How to Contact us .....</b>	<b>54</b>

## 1 About these Process Requirements

<b>NOTE</b>	
	<p><b>READ THE PROCESS REQUIREMENTS!</b></p> <p>Read this document to plan your system.</p> <p>The process requirements described in this document are only to be viewed as recommendations for your system.</p> <p>The system integrator and the operator are responsible for compliance with applicable legal and local regulations for environment, health and safety (EHS).</p>

### 1.1 Objective of these Process Requirements


This document contains a detailed description of all process requirements of the inge<sup>®</sup> product Series:

→ [dizzer<sup>®</sup> L Series UF Modules for Horizontal Systems](#).

This manual provides instructions and rules for correct, safe and fault-free operation of the inge<sup>®</sup> dizzer<sup>®</sup> L product series for replacement of existing third party UF membranes installations.

Please contact inge<sup>®</sup> to resolve potential deviations between instructions and rules within these process requirements and operating conditions for the existing UF installation.

### Warranty Policy

<b>NOTE</b>	
	<p><b>ADHERENCE TO ALL INSTRUCTIONS!</b></p> <p>Full and proper compliance with the instructions in these process requirements is a prerequisite for making a claim under the warranty.</p> <p>The only version of these process requirements of the above mentioned inge<sup>®</sup> product Series: dizzer<sup>®</sup> L Series UF Modules for Horizontal Systems that has legal validity is the English version.</p> <p>In the event of making a warranty claim, the operator agrees to automatically provide inge GmbH with a complete set of documentation.</p> <p>Please contact inge GmbH if you wish to deviate from any of the requirements or specifications provided in this document and request written approval in advance. Otherwise, you risk invalidating any warranty claims that you may make in the future.</p>

- Full and proper compliance with inge<sup>®</sup>s specific product documentation (including assembly manuals and process requirements) are a prerequisite for making a claim under the warranty. In the event of making a warranty claim, the operator agrees to automatically provide inge GmbH with a complete set of documentation as requested by inge GmbH.
- Please contact inge GmbH if you wish to deviate from any of the requirements or specifications provided in inge<sup>®</sup>s product-specific assembly manuals and process requirements and request written approval in advance. Otherwise you risk invalidating any warranty claims that you may make in the future.

## 1.2 Target Groups




### Qualified Persons

- Project and planning engineers/technicians
- Programmers
- Commissioning engineers/technicians

## 1.3 Symbols in this Process Requirements


### 1.3.1 Symbols

The following symbols are used in this document:

<b><i>SYMBOL</i></b>	<b><i>DESCRIPTION (EXAMPLES)</i></b>
	<b>IMPORTANT NOTE!</b> Failure to follow the instructions in this note may lead to problems with operating the product.
	<b>INFORMATION!</b> Following the information provided in this note will simplify commissioning and operation of the inge® products.
	<b>CROSS REFERENCE!</b> Detailed information on this topic can be found in other documentation.

### 1.3.2 Notes on Instructions and Rules

To ensure correct, safe and fault-free operation of the system, the document highlights instructions and rules in the following manner:

<b><i>NOTE</i></b>	
	<b>ATTENTION!</b> Observe the following requirements!

## 2 The inge<sup>®</sup> Product Family

### 2.1 Multibore<sup>®</sup> Membrane Technology

The Multibore<sup>®</sup> membrane developed by inge GmbH (see Figure 2.1-1) combines seven capillaries of the same diameter into a single fiber. This provides significantly higher mechanical stability than conventional singlebore hollow fiber membranes. Multibore<sup>®</sup> membranes are typically operated in dead-end mode and are backwashed at regular intervals.



*Figure 2.1-1 - Multibore<sup>®</sup> membrane developed by inge GmbH*

The Multibore<sup>®</sup> membrane is "spun" in a single production step from just one polymer solution in a patented production process. Spinning the membranes using just one material creates what is known as an "integral" membrane. Unlike composite membranes, which consist of multiple layers of various materials, integral membranes do not pose the risk of individual layers peeling away. This is a huge advantage in terms of membrane integrity.

The PES based membrane material is modified in a way that boosts the hydrophilicity of the membrane. This increased hydrophilicity reduces the tendency of the membrane surface to adsorb organics, thereby improving operating performance with less membrane fouling. The manufacturing process produces a defined thin filtration surface (interface) on the inside of the seven capillaries with extremely low resistance to permeation and with inner pores measuring approximately 20 nanometers (see Figure 2.1-2). This pore size is substantially smaller compared to low pressure membranes of most other ultrafiltration membranes on the market. This ensures a virus rejection of more than 4 log units without any pretreatment step like coagulation and in addition a better removal of foulants if used as pretreatment for reverse osmosis plants. In spite of the smaller pores, the Multibore<sup>®</sup> membrane shows a substantially higher permeability because of the higher surface porosity. This is translated into a very energy efficient operation.

The individual capillaries are firmly connected to each other by a homogeneous support structure that has a permeability some 1,000 times higher than that of the actual filtration interface of the capillaries. The capillaries are spaced at defined distances from each other to ensure a uniform distribution of water within the Multibore<sup>®</sup> membrane and superior overall stability.

Smaller pores, lower pressure, the unmatched resistance against high pH cleaning for removing organic foulants and of course the stability are only a few unique characteristics of the Multibore<sup>®</sup> PES membrane.

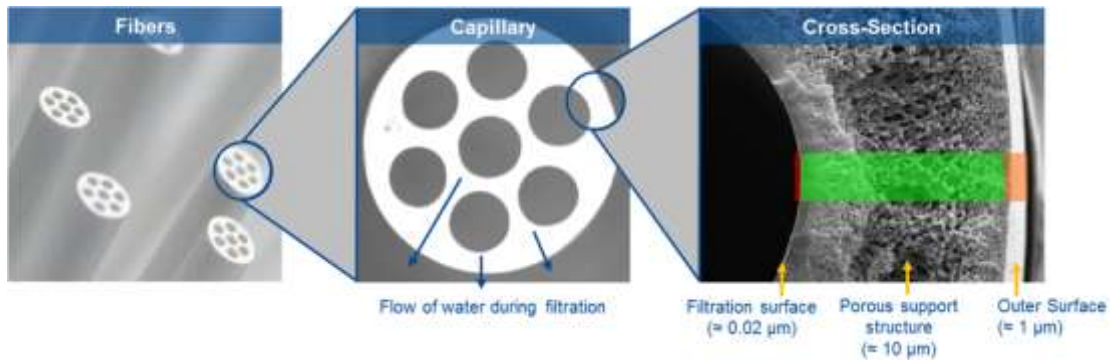


Figure 2.1-2 - Cross-section of a Multibore® membrane

Multibore® ultrafiltration membranes operate "inside-out", which means that the feed water flows from the inside to the outside of the capillaries in filtration mode and flows in the reverse direction, i.e. from the outside to the inside of the capillaries, in backwash mode.

inge® Multibore® ultrafiltration membranes reliably remove particles, bacteria and viruses from a variety of water sources, even if fluctuations in the quality of the feed water exist. Maintaining the integrity of the membrane fibers is a key prerequisite for ensuring that contaminants are properly removed from the system. Although capillary defects are extremely unlikely due to the extraordinary stability of Multibore® membranes, the integrity of the membranes or capillaries can still be affected negatively by factors such as non-approved substances in the feed water and, in particular, by excessive mechanical stress caused by improper operation.



## 3 Membrane Operating Modes

### 3.1 Filtration

In filtration mode, the source water is treated by being forced through the ultrafiltration membrane from the feed side to the filtrate side. The contaminants in the water, which are blocked by the filtration surface, accumulate on the inner surface of the membrane capillaries. The filtrate flows into the filtrate/backwash tank, which serves as a storage container for the backwash water and the water that is to be used for further processing or consumption. Alternatively, the filtrate can be piped directly to the ultimate consumers, in which case the tank is used solely as a storage container for backwash water. The amount of water that can be treated by each UF module depends on a number of factors, including the origin of the water being treated (e.g. ground water, surface water, sea water, or pretreated waste water), the composition of the source water (e.g. turbidity, concentration of solids, dissolved organics/inorganics, temperature), and the chosen cost strategy (capital cost, operating costs).

inge® dizzer® L UF modules are installed inside pressure vessels, typically up to 4 modules in each vessel. Vessels are placed in parallel and then stacked vertically to create UF racks with the required number of modules for provision of the desired UF membrane surface area. Flow path is illustrated in Figure 3.1: UF feed water is pressurized by the UF feed pump and then pumped through the UF module(s) at fixed rate through the UF membrane, towards the UF filtrate side. Operation occurs in “dead end” mode, by which all UF feed water is converted to UF filtrate water while particulate is rejected by the UF membrane. UF feed and filtrate sides are continuously vented throughout the filtration process using automated vent valves.

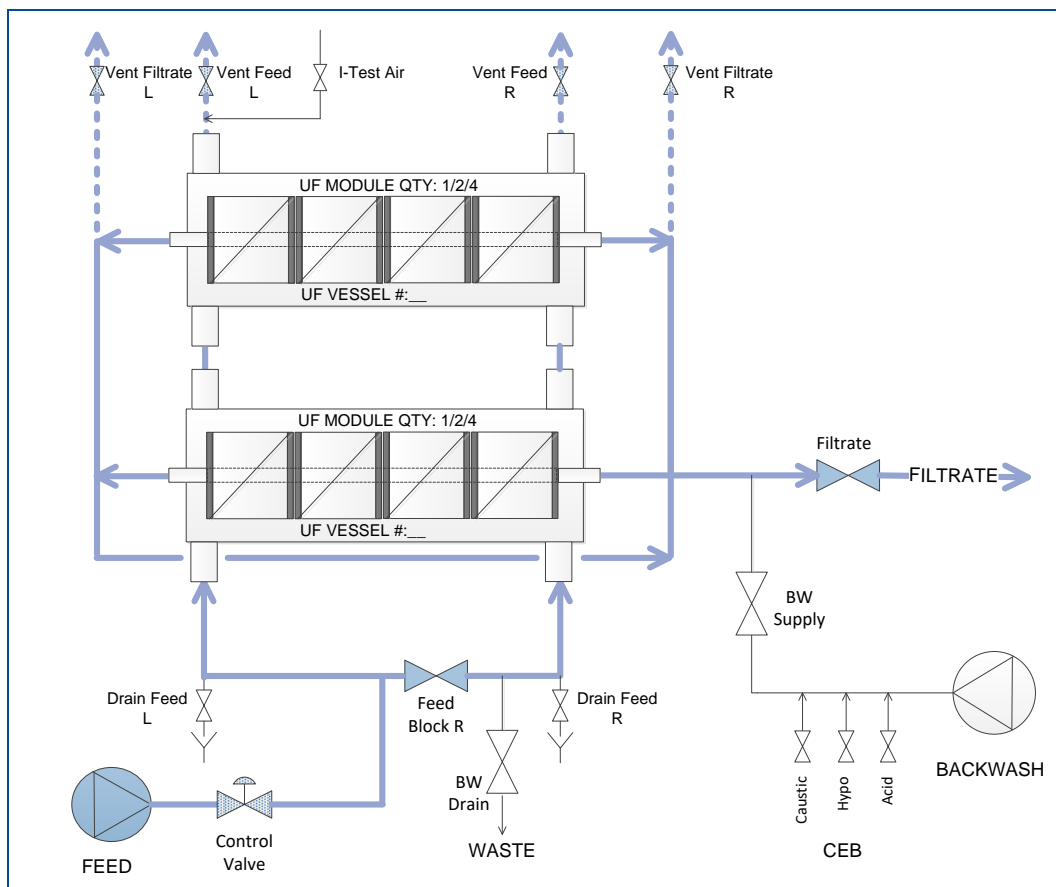



Figure 3.1 – Filtration – exemplary configuration

## 3.2 Backwash

During the filtration process, the contaminants accumulate on the UF membrane surface and form a filtercake. As a result, the pressure drop required for filtration – also known as the transmembrane pressure (TMP) – increases gradually. In order to remove the build-up of foulant from the membrane surface and reduce the TMP, backwashes are performed at regular intervals. The water required for the backwash is drawn from the backwash tank and forced through the module from the filtrate side using the backwash pump. It passes through the membrane from the outside in (i.e. opposite to the direction of flow used in filtration mode) and detaches the accumulated foulant from the membrane surface. The backwash water is then rinsed out of the fiber capillaries and channeled through the module inlet connection to the drain.

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- The backwash water must be free of abrasive or membrane-blocking particles, i.e. the level of water cleanliness must be at least as high as that of inge® UF filtrate. When drawing water from the backwash tank, it is also important to ensure that no corrosion or erosion products that may have formed in the tank or in the pipes are reversed flowed and thus preventing a contamination of UF module(s) filtrate side.
- To be sufficiently effective, the backwash must be conducted at a flux rate of at least 230 and max. 300 l/m<sup>2</sup>h (135-176 GFD).

Effective backwash duration varies between 30 and 60 seconds depending on the quality of the feed water, the type of operating cycle and the size of the installation.

- To ensure reliable cleaning even when the membranes are heavily fouled, it is important to maintain a constant flow rate using a flow control system. Typically, backwash water flow control is achieved by using a backwash pump driven by a frequency converter. The frequency converter should be configured to ensure that the min. flux rate of at least 230 and max. 300 l/m<sup>2</sup>h (135-176 GFD) is achieved within 5 – 7 seconds or less without pressure surges. The use of slow acting valves is advised to avoid possible water hammers.

## Backwash Operating Mode

Figure 3.2 illustrates the flow path for backwash operation. Here, the backwash pump pressurizes the backwash water to enter the UF module(s) in reverse direction, from filtrate side, through the UF membrane towards the feed side. Backwash water is introduced simultaneously through the right and left filtrate ports of each pressure vessel. The backwash water ultimately exits the modules through both feed ports from where the water is directed to the BW drain outlet.

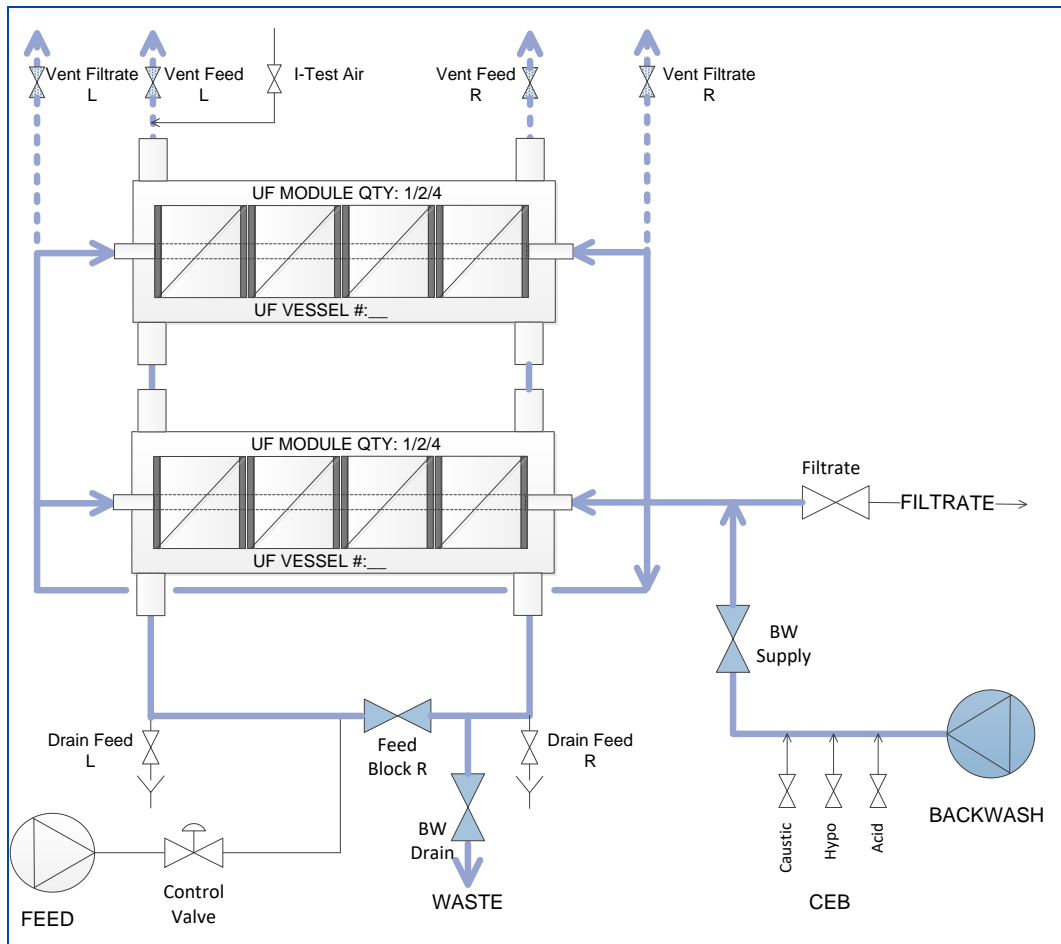


Figure 3.2 – Backwash – exemplary configuration

## 3.3 Operating Cycles

In this context, an ultrafiltration operating cycle refers to a sequence of operations comprising a filtration sequence followed by a backwash sequence. The duration of operating cycles should be user settable to allow for maximum process flexibility.

### Repetitive Operation

Filtration (Filt) / backwash (BW) is followed by filtration (Filt) / backwash (BW) and so on in a continuous repetition as shown in Figure 3.3-1 (below).

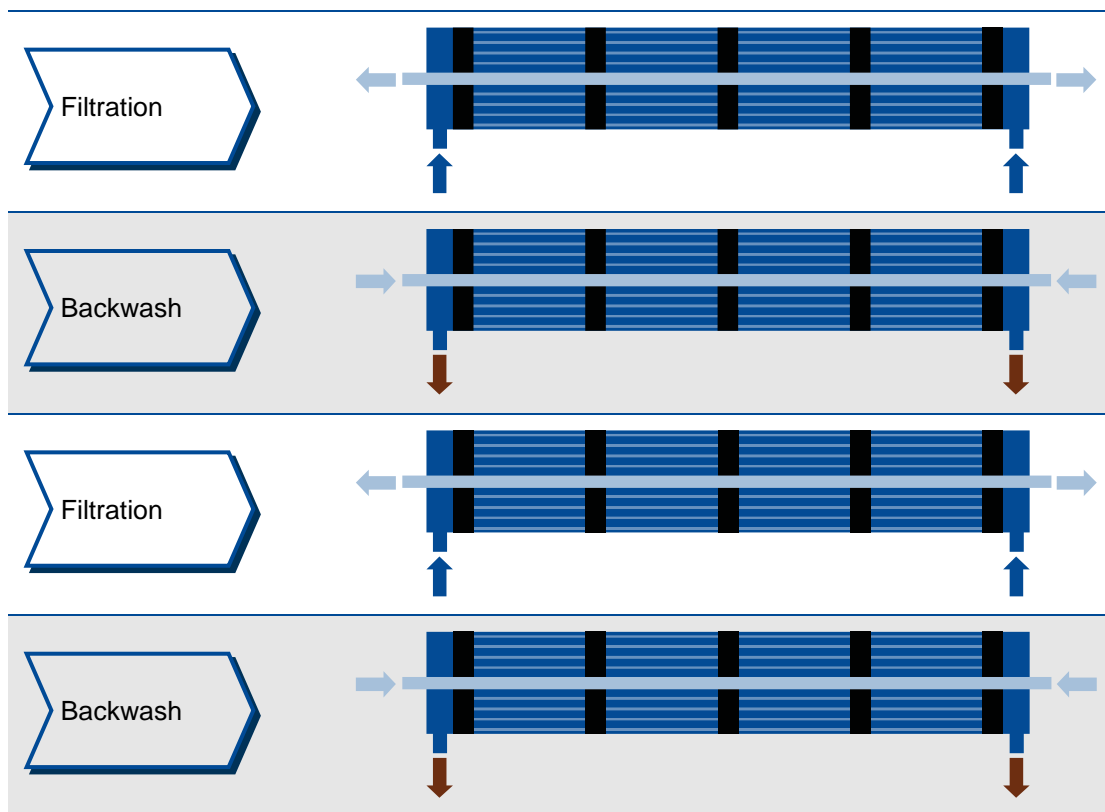



Figure 3.3-2 – Operating Cycles – exemplary configuration

## 4 Feed Water Quality and Pretreatment

### 4.1 Maximum Feed Concentration and Goals of Pretreatment

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- In some situations, the feed water may contain or may be expected to contain substances that could potentially damage the membrane or membrane fibers or that may cause fouling or scaling which would be too complex to remove even with chemical CIP (Clean In Place) cleanings. In such cases it is essential to carry out effective pretreatment steps to remove these substances from the water prior to ultrafiltration.
- The presence of predominantly large particles in the feed water may result in irreversible fouling of the capillaries or in damage to the membrane or membrane fibers. Large and/or sharp particles must therefore be removed by an upstream screen filter.

The quality of the water fed into a membrane system has a major impact on the membrane's performance, recovery and availability. Substances in the water that permanently exceed a critical concentration or temporarily rise above a maximum concentration can cause flux rates, achievable permeability and recovery rates to fall below the stated design values. This also applies to the dosing of inorganic iron or aluminum-based coagulants and powdered activated carbon. Concentrations that exceed permitted levels may also significantly increase the frequency of chemically enhanced backwashes (CEB) required to maintain stable operation as well as the frequency of chemical clean-in-place (CIP) to remove stubborn fouling/scaling substances. This could lead to higher chemical consumption and negatively affect system availability.

No fixed values can be given for critical and maximum concentrations of feed water contaminants. Membrane compatibility of many contaminants will differ depending on the type and even the sub-type of the source-water used and the exact nature of the encountered contaminants, such as e.g. the type and quality of the added powder activated carbon.

## 4.2 Microflocculation

### General Overview

Dissolved organic substances (DOC) in the UF feed water can cause build-up of a hydraulically hard to remove fouling layer as well as contaminate the UF filtrate water due to passage through the UF membranes. Microflocculation is used to prevent or reduce the negative effects of dissolved organic matter by precipitation and ultimately rejection of the organic molecules on the UF membranes. In many ultrafiltration installations, microflocculation by means of inline coagulation is thus effectively used as a pretreatment process. In contrast to sedimentation and depth filtration, which require the formation of larger macroflocs, ultrafiltration only requires coagulation with subsequent formation of so-called “microflocs”. This has the advantage of reducing the required quantity of coagulants and minimizing the quantity of sludge produced.

Depending on the concentration and characteristic structure of the dissolved organics in the feed water, specific quantities of inorganic coagulant (usually metal salts such as  $\text{FeCl}_3$ , polyaluminum chloride (PACl)) are added to the water prior to ultrafiltration and moderate amounts of energy, in the form of mixing, are then applied to form microflocs. The principal effects are a reduction of free organic contaminants as a result of the binding of the dissolved organics in the iron or aluminum flocs and the formation of a porous coating layer of microflocs on the membrane surface which helps to promote a stable filtration process and high backwash effectiveness and can therefore be used to increase or stabilize the membrane performance.

In addition, proper application of the microflocculation process can improve the filtrate water quality, particularly in regard to the concentration of DOC (which in many cases can be reduced by up to 60%), the SDI (Silt Density Index = clogging index; a key quality parameter for a reverse osmosis system downstream from the UF system), and the phosphate concentration (especially important in waste water applications).

When performing microflocculation, it is important to note that the concentration of the residues of dosed metal salts in the filtrate should not exceed 1% of the added metal concentration and should under no circumstances exceed any relevant limits that may apply (e.g. for drinking water treatment).

## 4.3 Performing Microflocculation

The goal of microflocculation (by using inline-coagulation) is to remove as much DOC as possible while simultaneously maintaining process conditions to minimize the amount of coagulant that remains in the UF filtrate. Achieving this goal requires precise adjustment of the inline-coagulation process. Based on the type of coagulant and the quality of the source water, an acid or caustic must be used to adjust the pH value in order to ensure an optimum pH for coagulation and microflocculation. The required contact time for the coagulant depends on the type and concentration of the coagulant, the water chemistry and the water temperature.

In order to define the best possible coagulation parameters, inge® recommends conducting jar tests in a preliminary phase. The coagulant dosing system can then be designed based on the results of these tests. It is important that the jar tests focus on analytical parameters such as residual concentrations of Al<sup>3+</sup> and Fe<sup>3+</sup> and DOC removal rather than optical parameters such as floc formation. Table 4.3-1 gives an overview of various coagulants and their key characteristics.

*Table 4.3-1 - Inline-Coagulation and micro-flocculation parameters*

Coagulant		FeCl <sub>3</sub>	PACl
Dosage of Fe <sup>3+</sup> /Al <sup>3+</sup> <sup>1</sup>	[mg/l]	0.3 - 7.0	0.2 - 5.0
Specific dosing (Me <sup>3+</sup> /DOC)	[mg/mg]	0.5 - 2.0	0.25 - 0.5
pH range		5.0 - 10.0	6.5 - 7.5
pH optimum		6.8 - 7.0	6.8 - 7.0
Contact time <sup>2</sup>	[s]	30 - 60	30 - 60
DOC elimination rate <sup>3</sup>	[%]	10 - 60	10 - 60
Rest quantity (as percentage of dosage) <sup>4</sup>		1%	1%

- <sup>1</sup> The dosage can be decreased for swimming pool applications (e.g. 0.03 mg/l Al<sup>3+</sup>/Fe<sup>3+</sup>).
- <sup>2</sup> Contact time may show significant variation depending on water temperature, pH value, water chemistry and treatment goals (t < 30 seconds and t > 60 seconds) → potential for optimization.
- <sup>3</sup> Removal of organics depending on water chemistry and coagulation parameters (pH value, etc.).
- <sup>4</sup> Significant residues of Me<sup>3+</sup> (metal salts) indicate a problem with the coagulation parameters (mixing conditions, pH value, alkalinity, contact time, dosage) and should be strictly avoided.

It is important to note here that using the prefilter to mix the coagulant may lead to fouling or scaling of the prefilter (e.g. precipitation of  $Al^{3+}$  hydroxides). Inge GmbH therefore recommends installing the prefilter upstream from the coagulant dosing station or downstream from the contact zone. In the event that the existing piping does not guarantee sufficient contact time, a contact tank can be installed to increase the coagulant contact time. The following process diagrams show a range of different configurations for inline-coagulation and microflocculation.

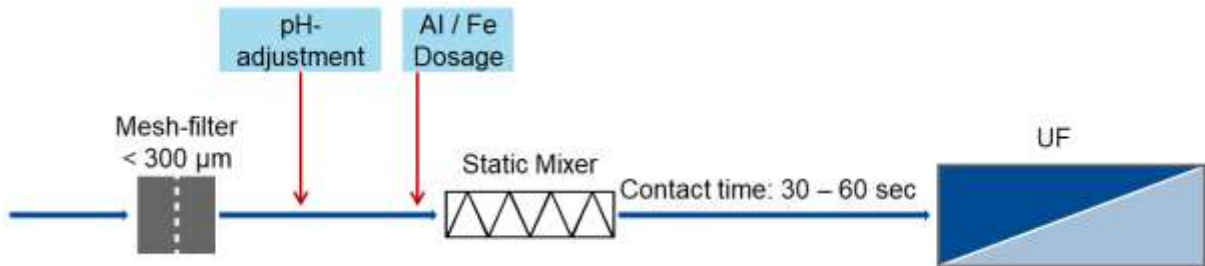


Figure 4.3-1 - Example 1: Pre-filter – microflocculation – static mixer - UF

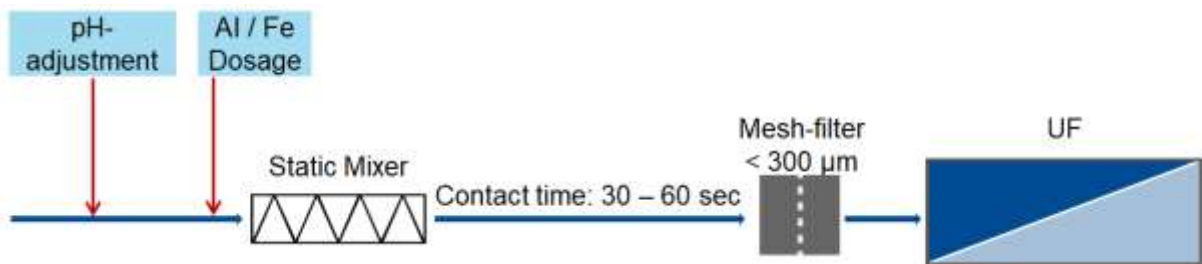


Figure 4.3-2 - Example 2: Microflocculation – static mixer – pre-filter – UF

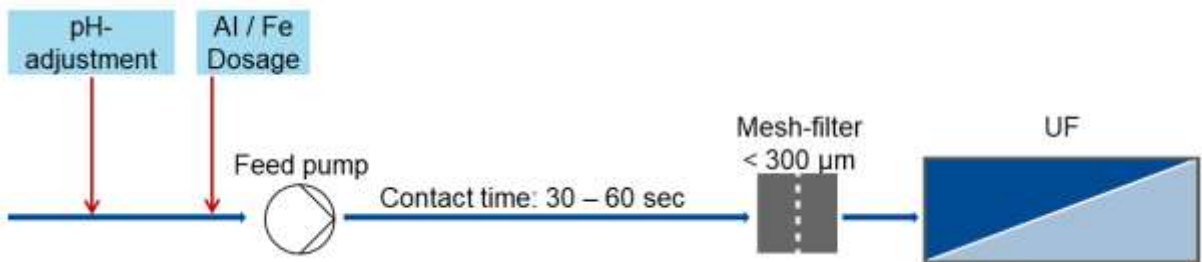


Figure 4.3-3 - Example 3: Microflocculation – feed pump – pre-filter – UF



## NOTE



### ATTENTION!


Observe the following requirements!

- It is important to ensure proper mixing and adequate contact time. To achieve the best microflocculation results, the contact time for the chemicals should be adjusted to reflect the source water quality (e.g. temperature) and the requirements regarding filtrate water quality (e.g. DOC, residual concentration of  $Al^{3+}$  or  $Fe^{3+}$  in the filtrate). Under no circumstances should microflocculation be allowed to take place in the membrane or on the filtrate side of the membrane (this would be the case if coagulants were not able to fully react with the UF feed water due to restrictions in timing and/or mixing and lead to unacceptable precipitation processes in or on the membrane surface).
- All chemicals added to the membranes and modules must at least comply with technical quality grade. Contaminated chemicals can cause irreversible fouling and are not permitted to use.
- When designing the microflocculation, please note that microflocculation processes are significantly slower at low temperatures ( $< 5 - 10\text{ }^{\circ}C$ ). To counter this, Inge GmbH recommends using polyaluminum chloride (PACl) which reacts significantly faster than other coagulants at low temperatures.
- When calculating the size and shape of the contact tank, it is important to choose a design that avoids short-circuiting in the tank.
- Special instructions must be followed for CEB and clean-in-place (CIP) and regular acid cleanings have to be performed once coagulants are introduced to the UF feed water.
- No organic coagulants or coagulation aids (e.g. polyelectrolytes) may be used either alone or in combination with inorganic coagulants since this may lead to severe, chemically irreversible fouling on the membranes which even CIP cleanings may be unable to remove. In certain special circumstances it may be possible to use substances of this type, but only if this has been tested and approved in writing by Inge GmbH in advance.
- To avoid excessive dosing of coagulants, it is important to monitor and document the concentration of coagulants in the source water, feed and filtrate.

## 4.4 Continuous Chlorination in UF feed water

In some cases, continuous pre-chlorination is used as a form of pretreatment to combat bacterial growth in water treatment facilities. For a number of reasons, it is not recommended to apply pre-chlorination for UF.

Continuous chlorination of the UF feed water is in some cases considered to prevent micro- and macro-biological growth in the UF feed water intake structures, however, it is not recommended to apply such continuous chlorination upstream of the UF system. Instead, inge GmbH advises to implement other intake cleaning strategies such as shock chlorination (see below).

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- Chlorine is a powerful oxidant which can lead to the formation of volatile chlorinated hydrocarbons in water chlorination processes. This by-product occurs as a result of free chlorine reacting with organic material. The best-known by-products are trihalomethanes (THMs), a class of chemicals that includes chloroform, which has been shown to cause cancer in laboratory animals, and chloramines, which are believed to trigger allergies, and which cause the chlorine smell associated with chlorinated swimming pools.
- THMs and other chlorinated hydrocarbons that are formed as by-products in the chlorination process are grouped under the parameter AOX, which stands for adsorbable organic halogen compounds. There are threshold values for waste water discharge in many countries.
- Experience has shown that the use of continuous chlorination in the feed water to ultrafiltration is highly counterproductive. Chlorination of organic matter creates numerous tiny organic fragments which can cause blockage of the membrane pores.
- In addition, the organic fragments produced by chlorination also tend to be bioavailable, a situation that is compounded by the significant increase in the rate of bacterial growth in the water if the free chlorine is neutralized. Together, these factors lead to an increase in the formation of biofilms (biofouling) on any downstream equipment or processes (e.g. reverse osmosis membranes).


For this reason, continuous chlorine dosing should not be used as a pretreatment stage.

- A better choice for pretreatment is a process known as shock chlorination, which involves adding a high dose of chlorine to the source water for a short period of time at less frequent intervals.

## 5 Chemically Enhanced Backwash (CEB)

### 5.1 General Overview

A chemically enhanced backwash (CEB) is used to boost the effectiveness of a backwash. It is performed after a defined number of operating cycles.


<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- If a CEB is executed with a reduced flux (less than 230 l/m<sup>2</sup>h), a backwash should be performed first. This enhances the effectiveness of the cleaning solution in the subsequent CEB.
- A CEB may only be performed using water of at least inge<sup>®</sup> UF filtrate quality or reverse osmosis permeate. The water used must be free of abrasive and membrane-blocking particles. When drawing water from the tank for a CEB, the same rule applies as for normal backwashes, e.g. ensure that no corrosion or erosion products that may have formed in the tank or in the pipes are washed into the module.
- CEB frequency depends on feed water quality and other operating conditions such as flux rate and recovery rate. The CEB is usually carried out several times a week.
- It is important to ensure that the CEB chemicals are injected into the system for a sufficiently long period of time to ensure that they are distributed evenly and homogeneously throughout the entire rack.
- The effectiveness of a CEB depends not only on the chemicals used, but also on the soaking time and the operating cycles and time intervals between CEBs. The sequence of the various CEBs should therefore be programmed as flexibly as possible.
- For the vast majority of applications, alkaline CEBs have proved to be the best choice for removing organic build-up and acid CEBs have been proven as the best solution for removing inorganic fouling.
- Since there is always the possibility of precipitation in an alkaline CEB, this must always be followed by an acid CEB. It is advised to operate the membrane system for one filtration cycle between a caustic CEB and an acid CEB in order to refill the backwash tank and neutralize the water in the membrane fibers.
- An alkaline CEB should always be performed in combination with acid as a caustic/acid CEB. Acid CEBs may be performed as a standalone procedure or in combination with caustic as a caustic/acid CEB.
- If iron-based coagulants are used in the pretreatment stage, the residue can only be removed by an acid CEB. If aluminum-based coagulants are used, then either acid or alkaline CEBs may be performed.

- If using a coagulant in the pretreatment stage, it is essential to perform an acid CEB no later than 6 to 8 hours before any CEB that involves chlorine. This is in order to avoid the catalytic formation of highly oxidative hydroxyl radicals due to the breakdown of chlorine and to prevent coagulant from being deposited on the membrane. Before adding the chlorine, it is important to ensure that the acid CEB solution has been completely rinsed out of the module. It is therefore necessary to perform at least one operating cycle (= filtration and cleaning sequence) between the acid CEB and a chlorine CEB.
- Chlorine containing CEB solution rinsed out of the system should under no circumstances be mixed with acid CEB solutions (e.g. in a neutralization tank), since this could lead to the formation of toxic chlorine gas.

The CEB's mentioned in Table 5.2-1 or their combination - with defined frequencies - are used depending on the application and feed water quality. The following points must be considered during the programming or organization of the CEB sequences.

## 5.2 Types of CEB

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- A caustic/acid CEB sequence is treated as a single CEB. In Table 5.2-1, this is designated as CEB 1 and is divided into an alkaline CEB 1.1 and an acid CEB 1.2. If an oxidant is added to the alkaline CEB 1.1, it is referred to as CEB 1.1 (B); if no oxidants are added, it is designated as CEB 1.1 (A).
- The acid CEB is designated as CEB 2 (Table 5.2-1). The acid CEB 2 is considered stand-alone, which means it is used independently from other CEB's to enable the effective removal of foulant build-up caused by inorganic water constituents or coagulants (e.g. FeCl<sub>3</sub>, PACl).
- The oxidant CEB is designated as CEB 3 (Table 5.2-1). CEB 3 is considered stand-alone, which means it is used independently from other CEB's. It is only required in applications involving the treatment of water discharged from a wastewater treatment plant.

*Table 5.2-1 - Organization of the CEB's*

	CEB 1			CEB 2	CEB 3
<b>Note</b>	Sequence of two chemical cleaning stages (CEB 1.1 and CEB 1.2): caustic followed by acid			Single stage, Performed separately from other CEBs	Single stage, Performed separately from other CEBs
<b>Purpose</b>	To clean off organic deposits and then to clean off inorganic deposits and/or remove precipitation			To remove inorganic deposits (including coagulant residue)	Disinfection
<b>Subprogram</b>	CEB 1.1(A)	CEB 1.1(B)	CEB 1.2	-	-
<b>Characteristics</b>	Purely alkaline	Alkaline + oxidative	Acid	Acid	Disinfection
<b>Chemicals</b>	NaOH	NaOH and NaOCl	HCl or H <sub>2</sub> SO <sub>4</sub>	HCl or H <sub>2</sub> SO <sub>4</sub>	NaOCl

Further advice for the programming of the control logic can be requested at inge GmbH.


## 5.3 How a CEB is Performed

The CEB is essentially performed in a similar way to a backwash, i.e. filtrate flows from the filtrate side to the feed side.

In addition, a cleaning chemical is added to the filtrate to boost the effectiveness of the process. Figure 5.3-1 shows the basic sequence of steps generally used to perform a CEB based on typical values for the respective parameter settings. The chemicals are introduced into the system using a defined flux rate (referred to here as the injection flux rate) of approx. 120 l/m<sup>2</sup>h (71 GFD), which is lower than the backwash flux rate.

Once the rack has been completely filled with cleaning solution (controlled by the chemical injection time setting) the injection process is stopped and the UF rack is isolated by closing all inlet and outlet valves.

This marks the beginning of the soak period. Once the soaking time has elapsed, the chemical solution and the substances removed from the membrane must be washed out of the module(s)/rack with filtrate. This is achieved by means of a rinsing step. The flux rate for rinsing out the solution should be at least 230 and max. 300 l/m<sup>2</sup>h (135-176 GFD) just like a normal backwash.

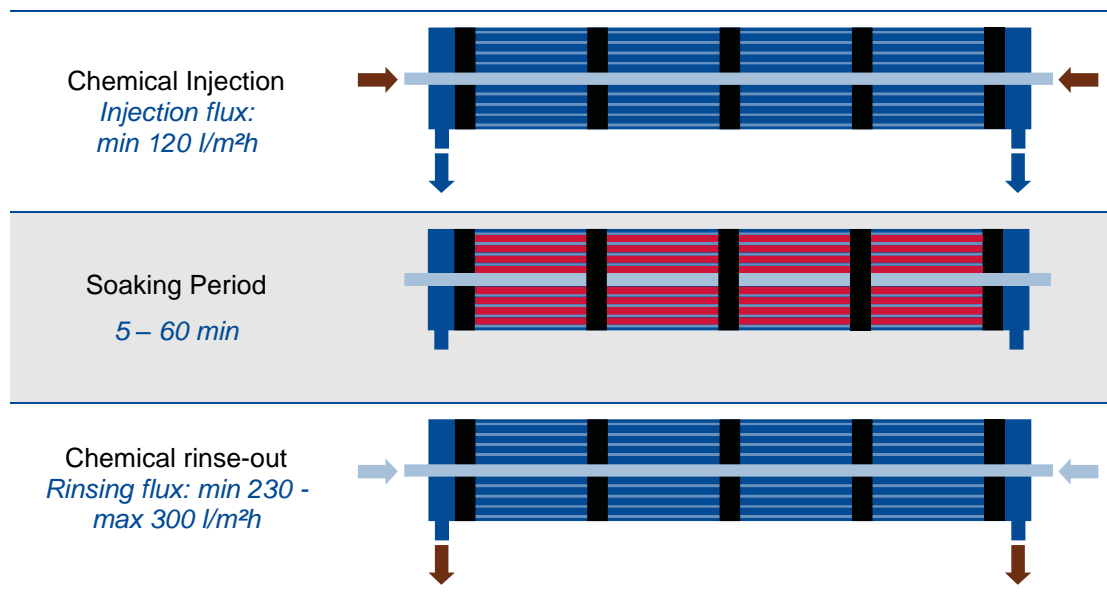

*Figure 5.3-1 - Chemically enhanced backwash (CEB) process with typical parameters for an injection flux rate of 120 l/m<sup>2</sup>h (71 GFD) – exemplary configuration*


Please note that BW is to be performed prior the CEB procedure to remove hydraulically reversible fouling. This BW can be part of the Filtration / BW sequences or (first) part of the CEB procedure if realized in the existing programming.

An alkaline CEB step is always complemented with an acidic CEB step as described in chapter 5.2. No BW is required prior the 2<sup>nd</sup> CEB step, if CEB steps are performed in immediate succession of each other.

The time required to wash the chemicals into the module(s)/rack in a CEB depends on the position of the chemical dosing points (referred to here as  $t_{ex}$  (= “external time”, which is defined as the time required for the CEB solution to make its way from the chemical dosing point to the rack), installed mixing devices, and on the respective flow velocities in the backwash piping and in the piping systems built into the rack.

At an injection flux rate of 120 l/m<sup>2</sup>h (71 GFD), the chemical injection time (measured from the moment the CEB solution enters the rack until the entire rack is completely filled) is referred to here as  $t_{int}$  (= “internal time” inside the rack).

The total chemical injection time is the sum of  $t_{int}$  and  $t_{ex}$  (see Figure 5.3-2). The precise figures for these two time periods should be calculated as part of the system commissioning process.

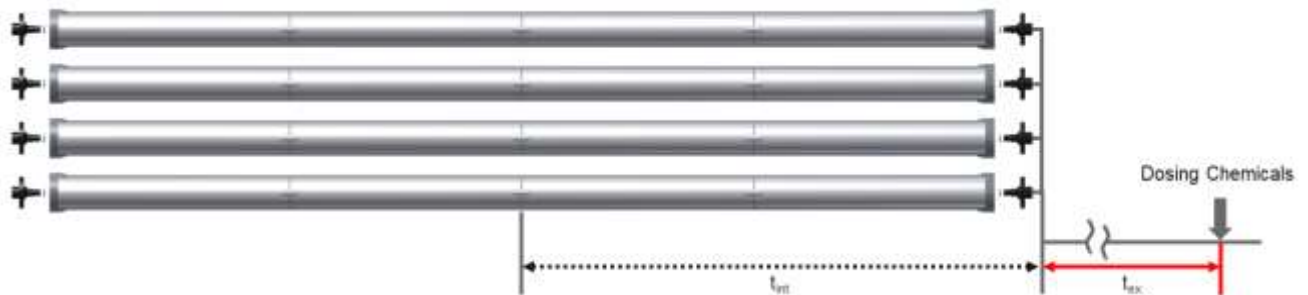

*Figure 5.3-2 - Total chemical injection time during CEB – exemplary configuration*

For the chemical injection process, the BW pump must be operated for duration of sum of ( $t_{int} + t_{ex}$ ) whereas the chemical dosing can be stopped after completion of  $t_{int}$  to allow the BW pump during the remaining time ( $t_{ex}$ ) to “push” the chemicals used in the CEB dosing process through the BW piping and into the UF racks, assuming plug flow.


## 6 Chemical Clean In Place (CIP)

### 6.1 General Overview

The inge<sup>®</sup> UF process is designed to maintain clean membrane state throughout the entire operation by both, hydraulic cleaning steps (backwash) and chemical cleaning steps (CEBs). The feed water can, however, contain contaminants (natural or introduced), which cannot be adequately removed by CEB.

A Clean-In-Place (CIP) procedure has been designed to restore membrane productivity for difficult to remove fouling and scaling. There are several different CIP chemicals and procedures available, depending on the nature of the foulant or scale. CIP is typically performed as a manual procedure; however, full automation of the CIP procedure(s) is also possible.

A CIP is performed by introducing a chemical solution into the modules and shutting down the individual UF-rack for a longer period of time than is required for conventional cleaning methods. One of the major differences to a CEB is that a CIP is characterized with the recirculation of different chemicals through the feed and filtrate sides of the membranes back into a CIP tank followed by an extended soak time (in some cases the feed tank can also be used as a CIP tank).

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- A CIP should be performed if the permeability of the system falls below 100 - 150 l/m<sup>2</sup>h/bar (4 - 6 GFD/psi) and if this drop cannot be reversed by performing a CEB. A CIP is rated as successful if the permeability of the system subsequent to the CIP is restored to a value of at least 70 – 80% of the reference value<sup>1</sup> recorded after the commissioning of the ultrafiltration system.
- Only those chemicals specified in the section "Using Chemicals for CEB/CIP" may be used for a CIP, and only in conformance with the concentrations and soak times specified. No other chemical(s) may be used unless prior written approval has been obtained from inge GmbH specifically agreeing to its use and stating the permissible concentration.
- The water used to prepare the CIP cleaning solution should be at least of drinking water quality. If reverse osmosis permeate is available, this should be used for the alkaline CIP. Please note that precipitation may occur in the CIP water, particularly if UF filtrate or water of drinking water quality is used for the alkaline CIP. An alkaline CIP must therefore always be followed by an acid CIP or alternatively by a standard acid CEB.
- The overall duration of the recirculation and soak time of a CIP depends on the effectiveness of its cleaning results, though it should not exceed 12 hours.
- A conventional backwash should be performed prior to a CIP to ensure that the membrane surface is as clean as possible and to rinse out any foreign particles that may be contained in the piping of the modules or racks.
- When performing a CIP, ensure that the modules and racks being cleaned are disconnected from the rest of the main system.

<sup>1</sup> Experience has shown that permeability falls during the initial running-in phase of a membrane, which generally lasts around one week, dropping from its initial level to a lower yet stable level of permeability which depends on a number of factors including the quality of the source-water. It is this subsequent, stable level that is classified as the reference value. The initial permeability of inge<sup>®</sup> modules lies somewhere in the range of approximately 700 l/m<sup>2</sup>h /bar (28.4 GFD/psi), while the reference permeability lies between 300 and 600 l/m<sup>2</sup>h /bar (12.2 – 24.4 GFD/psi) depending on the source water quality.



- The CIP solution must be fed into the rack from the feed side of the modules/rack. This prevents any damaging substances which could cause fouling or scaling from entering through the filtrate side of the membranes during CIP recirculation.
- In some applications it may be possible to improve the effectiveness of the cleaning process and reduce the soak time by heating the CIP solution. If a system is available to heat the CIP solution, this system must observe the maximum permitted temperature of 40 °C and the maximum permitted rate of temperature change of 5 °C/min. A significant amount of energy is required to heat the solution and the process of ensuring compliance with the maximum 5°C/min temperature change rate can be relatively complicated. Heating of the CIP solution is not necessary in the vast majority of application and is therefore not recommended when using inge<sup>®</sup> modules.
- Ensure adequate ventilation of the area before and while using cleaning chemicals.
- When preparing the chemical solution in a CIP tank (mixing together the cleaning chemical and water), the chemicals must always be added to the tank of water, not the other way around. Adding water to concentrated chemicals could cause a violent reaction.
- It is important to ensure that the CIP chemicals are recirculated in the system for a long enough period of time to ensure that they are distributed evenly and homogeneously throughout the entire rack in the concentration required in each case. If the concentration falls below the required value, more of the chemical must be added.
- Note that the concentration of the CIP solution will be diluted by the water stored in the rack including the manifold (known as the "hold-up volume") and that this hold-up volume may lead to precipitation in the case of an alkaline CIP. When performing a CIP using reverse osmosis permeate, it may therefore be a sensible idea to empty the rack including the manifold before injecting the CIP solution.
- To increase the efficiency of a CIP cleaning, inge<sup>®</sup> recommends performing multiple successive cleaning steps using different chemicals.
- If using a coagulant in the pretreatment stage, or if there are concerns that metals may have accumulated on the membrane surface, it is essential to perform an acid CIP before any CIP or disinfection process that involves oxidants in order to optimize the cleaning efficiency and to prevent coagulant from being deposited on the membrane. Ensure that the acid CIP solution has been completely rinsed out of the system before performing the oxidant CIP or disinfection process.
- Chlorine-containing CIP solutions should under no circumstances be mixed with acid CIP solutions (e.g. in a neutralization tank), since this could lead to the formation of toxic chlorine gas.

## 6.2 Establishing CIP Recirculation

The CIP tank must be designed large enough to ensure that the minimum level of water delivers sufficient initial pressure to the intake side of the CIP pump and that the previously empty pipes of the recirculation system can be filled. The total volume of the CIP tank is therefore obtained by adding together the following partial volumes:

- Empty volume of the CIP feed return piping (V1)
- Empty volume of the CIP filtrate return piping (V2)
- Empty volume of the CIP feed supply piping incl. fill volume pump(s) and strainer(s) (V3)
- Volume required to protect the CIP pump from running dry (V4)
- In seawater applications the UF rack has to be drained prior to CIP!

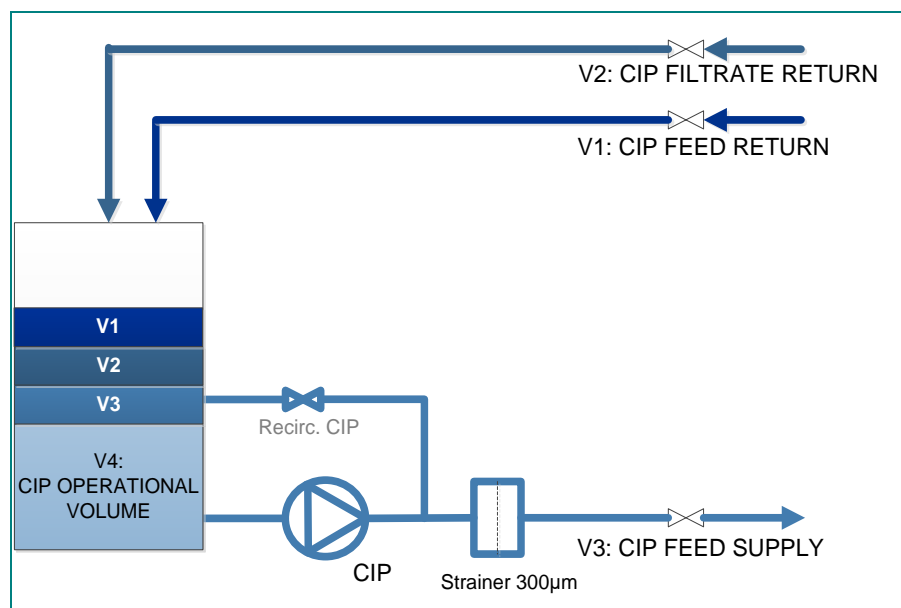


Figure 6.2-1 - Partial volumes for determining the size of the CIP tank

To protect the membranes from damaging particles, it is important to install a screen filter with a minimum cut-off of 300 µm in the recirculation system or at the point where the CIP solution is fed into the system. The recommended volume flow rate for cleaning all inge® UF modules is typically not less than 40 l/m<sup>2</sup>h (19.2 GFD). The maximum hydraulic pressure loss is 1 bar /14.5 psi.

[Design recommendation for the CIP cleaning pump capacity:

No. of modules x surface area / module x 40 l/m<sup>2</sup>h (19.2 GFD) = volume flow rate @ minimum 1 bar]

## 6.3 How a CIP is Performed

### 6.3.1 Preparing the Chemical Solution for a CIP

1. The CIP tank (or feed tank) is filled with UF filtrate, reverse osmosis (RO) permeate or drinking water. If available, RO permeate should be used for the alkaline CIP.
2. The cleaning chemicals are added to the water-filled CIP tank, not the other way around.
3. The chemical solution is mixed using a mixer or a special recirculation system. After mixing, check that the pH value and concentration of the solution correspond to the target values. It is important to ensure that the concentrations do not exceed the maximum concentrations specified in inge<sup>®</sup>'s specific product documentation.
4. (In seawater systems, there must be a rack draining step at this point).
5. If a heating system is to be used to heat the chemical solution, the heating process may not commence until the chemical solution has begun recirculating through the modules. Significant differences in temperature between the chemical solution and the water inside the modules could lead to stress cracks in the module and should therefore be avoided. Do not exceed the maximum permitted rate of temperature change or the maximum permitted operating temperature for the modules.

### 6.3.2 Preparing for a CIP Process

1. For a manual CIP, ensure that the valves are in the correct positions and that the connections are set properly for the cleaning cycle:
  - Cleaning solution inflow = CIP feed inlet connection
  - Cleaning solution outflow = CIP feed return connection
  - Filtrate outflow = CIP filtrate return connection
2. The cleaning solution must be pumped into the feed side of the UF modules and under NO circumstances from the filtrate side in the backwash direction since this could cause large-scale irreversible contamination or bacterial growth on the filtrate side.

### 6.3.3 Recirculation and Soak Time

1. In the first stage, recirculation should only take place via the feed side for at least 60 minutes in order to perform initial cleaning of just the fiber lumen. The filtrate valve is closed during this procedure.
2. Injection of the chemical solution into the fiber lumen on the feed side is triggered by starting the CIP cleaning pump. Set the minimum volume flow rate in accordance with the section "Establishing CIP Recirculation". It is important to ensure a feed side venting.
3. If the chemical solution is to be heated, it should be slowly heated to 30 - 35°C while it is recirculating through the system. Do not exceed the maximum permitted rate of temperature change or the maximum permitted operating temperature for the modules.
4. The readings of the temperature, pH value and concentration of the cleaning solution are to be continuously monitored and documented to ensure that they remain within the required range and within the scope of the permissible operating conditions. Long periods of recirculation could potentially heat the solution to a level above the maximum permitted temperature due to waste heat from the pump entering the equation. If the temperature exceeds the required level, this must be countered by adding fresh UF filtrate, RO permeate or drinking water. The pH value and chemical concentration should be adjusted to meet requirements.
5. Once at least 60 minutes have passed with the solution recirculating exclusively through the feed side, the process moves on to a second stage in which the filtrate side is incorporated in the recirculation process. The filtrate valve is now opened and CIP fluid is allowed to recycle through the feed return port and through the filtrate return port simultaneously. Normally, the flow rates should be of similar dimension which is acceptable for the CIP process. Recycle flow rates should nevertheless be verified for similarity

during the first CIP. Flow rate ratios are allowed to differ as much as 20 - 80% for compliance with this CIP procedure.

6. During the entire recirculation process, which should last for at least a further 60 minutes, it is important to ensure that the chemical solution recirculates through both - the feed and filtrate - sides.
7. Once the chemical solution has been recirculating through the system for approximately 2 hours, the process moves on to a third stage which alternates between soaking periods and recirculation through the feed and filtrate sides. In this third stage, the cleaning pump is stopped, the heating element is switched off, and the feed side valves are closed (ensure venting all the time).
8. As a rule of thumb, 60 minutes is sufficient for the soak time prior to the next recirculation, though longer soak times may be necessary in the case of stubborn fouling or scaling. To maintain a high temperature during lengthy soak times, a brief recirculation process lasting approximately 5 minutes should be conducted midway through the soak time.
9. The next steps involve alternating between recirculation through the feed and filtrate sides and soak times. Note that the duration of a recirculation period should not exceed 60 minutes and the overall duration of recirculation and soak time should not exceed 12 hours.

## 6.4 Preparing to Rinse out the Rack/System

1. Once the recirculation process has been completed, the chemical solution is drained from the CIP tank. Where required, the solution should be neutralized before being discharged. Ensure that the discharged solution complies with all the local regulations regarding discharges into the sewage system. Before emptying the CIP tank, ensure that the feed side valves of the modules/racks are closed.
2. Once the CIP tank is empty, it can then be refilled with UF filtrate, RO permeate or drinking water ready for the next rinsing process. It is not necessary to use RO permeate to rinse out the system even if this is available.

## 6.5 Rinsing out the Rack/System

With completion of the soaking period, the refilled CIP tank content is pumped through the UF unit to drain, ensuring clean water flow through and the UF feed and filtrate side. After completion of the clean water flushing from CIP tank, UF membrane rinsing is concluded using the UF backwash pump at standard backwash flow rate of at least 230 and max. 300 l/m<sup>2</sup>h (135-176 GFD).

If the chemical solution has previously been heated, the first step before beginning the rinsing process is to equalize the respective temperatures of the rinsing water and the chemical solution contained within the module/rack by stopping the CIP pump and waiting for the temperature inside the UF rack to return to ambient conditions. Alternatively, colder water can be added at slow rate to the CIP tank towards the end of the CIP recirculation. Significant differences in temperature between the rinsing water and the chemical solution inside the modules/rack could lead to stress cracks in the module and should therefore be avoided. Do not exceed the maximum permitted rate of temperature change or the maximum permitted operating temperature for the modules

Required duration of the CIP rinsing procedure must be determined by sampling of discharge water for residual chemicals (e.g. pH or free chlorine) and evaluated based on project specific permissible contaminant concentration.

During the rinsing process, the flow rate (flux rate), the temperature and the TMP (transmembrane pressure) should be monitored and documented in order to calculate the permeability and check the cleaning efficiency of the preceding cleaning process.


Once the rinsing process has been completed, the permeability should be monitored and documented in filtration mode in order to check the efficiency of the CIP. This should be conducted after every CIP, even if two CIPs are performed in succession.

## 7 Using Chemicals for CEB/CIP

### 7.1 Differences between CIP und CEB

CEB and CIP are both chemical cleaning processes to restore membrane permeability by removing a hydraulically irreversible fouling layer. The CEB is used typically once daily which is projected as sufficient to maintain satisfactory membrane permeability throughout the lifetime of the plant. The feed water can, however, contain contaminants (natural or introduced), which cannot be adequately removed by CEB.

CIP is used when membrane permeability can no longer be recovered by CEB. While a standard CIP can contain the same chemicals as a CEB, chemicals are recirculated and soaked at stronger concentrations, for extended durations and are in some rare cases heated, thus thoroughly cleaning the membrane surface and pores until clean conditions are reached. Special CIP cleaning agents can also be used in instances where standard CIP chemicals are not sufficiently able to clean the membranes. CIP is mostly applied as a manual procedure as it is not expected to occur frequently, however, the CIP can also be fully automated in the plant's SCADA system.

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- In addition to the instructions stipulated in this section, the performance of CEBs and CIPs is also subject to the permissible operating conditions stipulated in the individual sections.

### 7.2 Permissible Chemicals and Operating Conditions

The parameters of a CEB and, in particular, a CIP – for example, the type of cleaning chemical – should be tailored to the type of membrane fouling/scaling and thus to the quality of the water being treated. Three different types of water have been defined for this purpose:

- Water type A: Ground water and surface water
- Water type B: Discharge water from a municipal waste water treatment plant (secondary effluent)
- Water type C: Sea water

## NOTE



### ATTENTION!

Observe the following requirements!

- The permissible chemicals and operating conditions for the different types of water are listed in Table 7.2-1 for the CEB and Table 7.2-2 for the CIP. The only chemicals that are permitted for use in CEB and CIP are the chemicals listed here, and only in the concentrations and soak times specified in the tables. Written approval must be obtained from inge GmbH before using any other chemicals (e.g. specially designed membrane cleaners).
- All chemicals added to the membranes and modules must comply with at least “technical quality grade”. Contaminated chemicals can cause irreversible fouling and are not permitted.
- With the concentrations and soak times defined in Table 7.2-1 and Table 7.2-2 the chemicals listed here are generally a very effective choice for the CEB/CIP of inge<sup>®</sup> membranes, though in some cases they must be further adapted/optimized to cater to special source water situations. Should this be necessary, the modification of the parameters must be carried out in consultation with inge GmbH.
- Conducting an alkaline CEB/CIP may potentially lead to precipitation, though generally only to a minor extent. This precipitation can be removed by the subsequent acid CEB/CIP.
- The use of chlorine by itself without the addition of caustic is only required for system disinfection or system shutdowns. Since the potential for bacterial growth is far higher in waste water applications than in applications involving other types of water, systems used to treat waste water should be disinfected once a week in accordance with Table 7.2-1.

The organic acids (citric acid/oxalic acid) can be used to enhance the removal of inorganic foulant in the CIP (not in CEBs) and the surfactant sodium lauryl sulfate can be used to help remove organic foulant in an alkaline CIP.

The UF system does not retain salts. Consequently, the salt concentration in the UF filtrate remains unchanged in sea water applications and applications with high salinity. If UF filtrate is used for CEB/CIP in sea water applications, the high magnesium concentration (1,200 – 1,600 mg/l) means that magnesium hydroxide (MgOH<sub>2</sub>) precipitation begins to occur as soon as the dosage of OH<sup>-</sup> ions in the form of caustic soda (NaOH) reaches approximately 2 - 5 mmol/l (exact dosages can be determined by titration). This quantity of dosed NaOH corresponds to an increase in the pH value to approximately 9.5 - 9.7. As the dosing of caustic continues, the quantity of MgOH<sub>2</sub> precipitation increases up until the point at which there is virtually no magnesium left in the water. The pH value does not increase any further during this process. As a result of the very high magnesium concentration, the level of precipitation increases substantially if dosing is continued.

- When using ultrafiltered sea water for a CEB, we specifically advise against using NaOH dosages in excess of 2 mmol/l or setting the pH value > 9.5 - 9.7.
- If the UF system is being used as a pretreatment stage for reverse osmosis (for example in a sea water desalination or waste water reuse facility), RO permeate must be used for every alkaline CIP (with or without oxidants) in order to avoid precipitation and maximize the effectiveness of the CIP. For the same reasons, RO permeate is recommended to be used for an alkaline CEB (whether this is performed with or without oxidants). To reduce the use of RO permeate, UF filtrate can be used to rinse out the system after the CEB.

The key factors in using chemicals to remove irreversible fouling or scaling are, firstly, the required contact between the chemical cleaning solution and the membrane foulant and, secondly, the interaction between variables such as concentration, recirculation, soak time and temperature. The vast majority of cases also feature a combination of different types of foulant or scalant, which means that multiple cleaning steps are required to remove it. The use of chemicals at low temperatures reduces the effectiveness of the cleaning process and requires longer soak times and/or higher concentrations

Table 7.2-1 - Chemicals, Concentrations and Soak Times for CEBs

Chemicals	Water type A: Ground water and surface water	Water type B: Discharge water from a municipal wastewater treatment plant	Water type C: Sea water	Notes
Inorganic Fouling Scaling	pH-value	1 < pH < 2.5	1 < pH < 2.5	
	typical	pH 2.3	pH 2.3	
	Soak time	min. 10 - 60	10 - 60	
	typical	min. 15	15	
	pH-value	1 < pH < 2.5	1 < pH < 2.5	
	typical	pH 2.3	pH 2.3	
Sulphuric acid (H <sub>2</sub> SO <sub>4</sub> )	Soak time	min 10 - 60	10 - 60	
	typical	min 15	15	
	pH-value	12 ≤ pH ≤ 13	12 ≤ pH ≤ 13	
	typical	pH 12	pH 9.5	Seawater: using RO permeate for CEB pH 12.3 (12)
	Soak time	min 10 - 60	10 - 60	
	typical	min 10	10	
Organic Fouling	pH-value	12 < pH < 13	9.5 < pH < 9.7	
	typical	pH 12	pH 9.5	
	Soak time	min 10 - 60	10 - 60	
	typical	min 10	10	
	pH-value	12 < pH < 13	9.5 < pH < 9.7	
	typical	pH 12	pH 9.5	
Sodium hypochlorite (NaOCl) + Caustic soda (NaOH)	Concentration	mg/L max. 50	max. 200	
	typical	mg/L 20	20	Seawater: using RO permeate for CEB pH 12.3 (12)
	Soak time	min 5 - 60	5 - 60	
	typical	min 7	7	
	Concentration	mg/L > 1 mg/l < 10		The specified concentrations must be reached in the discharged rinse water at the end of the soak time
	Soak time	min 30		
Disinfection	Frequency:	1x per week		

Table 7.2-2 - Chemicals and Concentrations for CIPs (overall duration of soak time and circulation max. 12h)

Chemicals	Water type A: Ground water and surface water	Water type B: Discharge water from a municipal wastewater treatment plant	Water type C: Sea water	Notes
Inorganic Fouling Scaling	Hydrochloric acid (HCl) pH-value: typical:	1 < pH < 2.5 pH 2	1 < pH < 2.5 pH 2	
	Sulphuric acid (H <sub>2</sub> SO <sub>4</sub> ) pH-value: typical:	1 < pH < 2.5 pH 2	1 < pH < 2.5 pH 2	
	Citric acid pH-value: typical:	1 < pH < 2.5 pH 2	1 < pH < 2.5 pH 2	
	+ hydrochloric acid Concentration: g/L	pH 2 max. 10	pH 2 max. 10	
	or sulphuric acid typical: g/L	4	4	
	Citric acid g/L	4	4	
Oxalic acid g/L	4	4		
Organic Fouling	Caustic soda (NaOH) pH-value: typical:	12 < pH < 13 pH 12.5	12 < pH < 13 pH 12.5	Use RO permeate if available
	Sodium hypochlorite (NaOCl) pH-value: typical:	12 < pH < 13 pH 12	12 < pH < 13 pH 12	Use RO permeate if available
	+ Caustic soda (NaOH) NaOCl: mg/L typical: mg/L	max. 500 100	max. 500 100	
	Sodium lauryl sulfate pH-value: typical:	12 < pH < 13 pH 12	12 < pH < 13 pH 12	
	+ Caustic soda (NaOH) Concentration: g/L typical: g/L	max. 10 4	max. 10 4	Use RO permeate if available
	Sodium hypochlorite (NaOCl)			
Disinfection				



## 8 UF System Functionality

Following inge GmbH functionality requirements is a prerequisite for successful and trouble-free operation of UF systems. The given information is based on inge<sup>®</sup>'s experience in treating different types of source water.

The following parameters are the minimum basis needed to perform a feed water analysis:

- Particulate water constituents:
  - Turbidity / Total Suspended Solids (TSS)
- Organic water constituents:
  - DOC / TOC and SAK254,
  - For waste water: Chemical Oxygen Demand (COD) and Biological Oxygen Demand (BOD)
- Inorganic water constituents:
  - $\text{Ca}^{2+}$ ,  $\text{Mg}^{2+}$ , alkalinity /  $\text{HCO}_3^-$ ,  $\text{Fe}^{3+}$ ,  $\text{Mn}^{3+}$ ,  $\text{Al}^{3+}$
- pH value
- Temperature
- Seasonal Changes.

If the UF feed water quality and temperature of the source water is subject to seasonal changes, details on the range of fluctuation are also required for the analysis (ideally in the form of a distribution, otherwise at least stating the minimum, maximum and median values). Other important information for surface waters (and for source waters affected by surface waters) includes the duration and impact of heavy rain and flooding events.

The collection of detailed information to the project specific pretreatment steps and/or intake situation (e.g. for seawater systems) is recommended.

Validation of full functionality of the construction of an UF system is fundamental to achieving smooth, trouble-free operation. It also reduces the risk of damaging the membranes and modules or suffering irreversible loss of performance. Verification of proper compliance with the following functionality requirements is a key prerequisite for making successful claims under the warranty should this become necessary.

UF systems must be checked for construction related compliance prior installation of the dizzer<sup>®</sup> L serial horizontal modules.

## NOTE



### ATTENTION!

Observe the following requirements!

- The construction of any UF system should be based on state-of-the-art technology and in accordance with good engineering practices.
- The system should be specifically designed to avoid any pneumatic and/or hydraulic pressure surges or siphoning effects. All UF systems should include the following components and observe the following requirements:
- The system should include a means of controlling the feed and backwash volume flow rates (e.g. using frequency-controlled pumps or control valves with PID controllers). For the backwash pump controller, it is important to ensure that the set point value for the volume flow is reached within 5 - 7 seconds (time depends on pump capacity and valve dimension).
- The actuators of all (butterfly) valves should be equipped with air throttling valves to control the opening and closing procedure. Air/water hammer can occur if the valves open or close too abruptly.
- Air vent valves must be provided to vent the dead ends of the rack feed and filtrate headers to prevent pressure surges caused by air trapped in the dead end. Further air vent valves should be provided on all higher sections of the rack piping and connecting pipework.
- The rinse water piping must be equipped with vacuum breakers (air intake valves).
- The switching circuits of the pumps and valves must be designed to ensure that no pressure surges are produced in the system, e.g. the pumps and valves should be actuated in a controlled sequence at intervals of approximately one second so that pumps are never running against closed valves.
- Any change of operating mode that involves a switch between the feed and backwash pump, including the switching of the required valves (e.g. backwash to filtration) must include an idle interval of approx. 5 - 7 seconds between the completion of one operating mode and the activation of the subsequent operating mode.
- Every module in a membrane rack must be operated under the same operating conditions.
- When designing and constructing an ultrafiltration system, it is important to ensure that there are no dead spaces, particularly on the filtrate side, which could encourage microbial growth. For the same reason, it is essential that there is no direct connection between the feed and filtrate sides which could create a bypass between the two sides of the filtration process.
- When designing/constructing an ultrafiltration system, it is also important to ensure that no corrosion or erosion products from the feed tank, backwash tank or piping can be rinsed back into the modules. For this reason, the tanks used for source water, filtrate/backwash and Clean In Place (CIP) must be made of non-corroding materials which will not release any contaminants or damaging (e.g. abrasive) substances into the water. The same applies to the piping and all other components installed within the ultrafiltration system.
- The dosing pumps must be designed and scaled to meet the concentrations and pH values required for CEBs.
- Only air release valves may be used. The use of combination vacuum valves/air release valves or valves designed purely for vacuum breaking is not recommended (with the exception of vacuum breakers in the rinse water piping) in order to prevent air from accidentally entering the system.
- The use of gap-type/edge filters is not recommended for the required prefilter protection stage, which should have a maximum mesh size of 300 µm. The prefilter should be automatically backwashable.

- It is important to protect the water in the filtrate/BW tank and connecting pipework from direct sunlight and exposure to light in order to prevent excessive heating and avoid exposure to sunlight which could pose a risk of promoting bacterial and/or algae growth.
- Sealed filtrate/backwash tanks with air filters must be used to prevent microbiological contamination.

UF membranes cannot reject dissolved substances. This physical fact should be taken into account for all parameters (SDI<sub>15</sub><sup>2</sup>, turbidity<sup>3</sup>, etc.) when designing a UF system (including the effect on any downstream treatment processes) and when measuring UF filtrate quality.

- We recommend providing three chemical dosing points for CEBs for each membrane train (= independent backwashable unit with several modules). These dosing points should be as close to the train as possible. Experience has shown that it is sensible to place the acid dosing unit furthest upstream in the system. Any precipitation that builds up on the other dosing units further downstream can then be removed by means of acid dosing. It is important to ensure that the chemicals are properly mixed into the flow of water (mixing devices should be used if required). This system offers numerous advantages over the alternative of a central dosing unit:
- Reduces the volume of water that must be replaced when dosing and rinsing, thereby reducing dosing time.
- Avoids the mixing of different chemicals in the backwash piping which could otherwise occur if two CEBs were performed one immediately after the other for two different trains.
- Reduces chemical consumption and provides higher recovery rates because less water is used.
- Introduces fewer variables for the control system.
- When using coagulants in the pretreatment on an iron basis, residuals can only be removed with an acid CEB.


---

<sup>2</sup> SDI<sub>15</sub>; (fouling index) measurement according to ASTM D4189-94

<sup>3</sup> Turbidity to be measured using analytical sensors and procedures in compliance with ISO 7027 and/or, Standard Methods 2130 B.


## 9 System Commissioning

### 9.1 General Overview

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- System commissioning comprises functional testing and test operation.
- All inge<sup>®</sup> UF modules/racks must be put into operation in accordance with the functionality requirements stipulated below.
- The steps involved in commissioning the system must be logged and archived.
- inge GmbH recommends verifying the composition of the feed water quality before commencing the commissioning process.
- The operating personnel should be incorporated in the commissioning process.
- Before commencing water supply operations, the modules, racks, filtrate tank(s) and filtrate piping (including all the installed valves, fittings and devices) must be adequately rinsed and then disinfected.
- During system commissioning it is also necessary to determine the chemical injection times for the CEB by measuring the rise in concentration in the rinse water discharged from the rack during chemical dosing.
- Before commencing water supply operations, check that the water produced by the rack(s)/system meets the stipulated requirements.
- inge GmbH recommends performing integrity tests immediately after the commissioning is completed, as described in the section on "Integrity Testing". This is also an important means of determining the reference value(s) required for future testing. This/These reference value(s) must be determined and documented during the commissioning process for the fully assembled rack(s).

## 9.2 Functional Testing

<b>NOTE</b>	
	<b>ATTENTION!</b> Observe the following requirements!

Before beginning test operation, review the SCADA design. Verify that the automatic program control system (programmable logic controller, PLC) is running error-free. Consider checking all items on the below list for completion:


- Verify that all required system instruments are properly assembled and installed.
- Confirm data display, historic data archiving & processing.
- Confirm calculations TMP & permeability (hydrostatic offsets).
- Confirm permeability to be temperature corrected.
- Confirm dry operation all butterfly valves (functionality and adequate opening/closing speed).
- Confirm functionality all vent valves.
- Confirm filtration sequences functional.
- Confirm Backwash sequence functional.
- Confirm CEB set points adjustable.
- Confirm correct CEB sequence (caustic – acid – others, if applicable).

## 9.3 Module Preservation

The Multibore<sup>®</sup> membranes contain preservative in order to prevent the membranes from drying out, to protect the membranes from freezing temperatures during transport and storage and to inhibit microbiological growth in the membranes. Drying of the pores in the membranes would result in permanent permeability loss due to pore collapse, while freezing of the fluids in the pores could potentially damage the membranes. Microbiological growth wouldn't damage the membranes, but it would necessitate extensive oxidative cleaning.

inge<sup>®</sup>'s standard preservative solution consists of a mixture of glycerin (1,2,3 propantriol) and propylenglycol (1,2 propanediol). As both glycerin as well as propylenglycol are non-hazardous substances (approved as food additives), and are completely miscible with water, it is relatively easy to rinse these substances out of the modules.

## 9.4 Venting and Rinsing

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- After functional testing, but before test operation, the entire system including the piping, connecting pipework must be vented and cleaned to remove any contaminants, abrasive materials and oily substances from the system.
- Before filling the UF system/filtrate tank, it is important to thoroughly clean the filtrate tank to remove any contaminants.
- Ensure that the rinsing process removes the preservation solution from the system. The preservation solution is biologically available when sufficiently diluted with water. Consequently, it is possible that any residue of the preservation solution could cause microbial growth on the filtrate side or in the filtrate tank in certain circumstances.

### 9.4.1 Venting the System

To vent the module(s) prior to system commissioning, proceed as follows (the various operating modes are described in the section on "Membrane Operating Modes"). Below procedure applicable for each installed UF rack:

#### 1. Filling and venting the UF racks with source water

- Confirm that no valves are closed on the filtrate side.
- Fill the feed side of the system with source water slowly (to avoid water hammer) by venting and replacing entrapped air using the feed vent valves and optionally feed block valve(s) as directed by the existing automation logic.
- Fill the filtrate side with filtrated source water slowly (to avoid water hammer) by venting and replacing entrapped air using the filtrate vent valves and optionally feed block valve(s) as directed by the existing automation logic.
- After filling of the rack is completed, run the system in filtration mode at a flux rate of approximately 40 l/m<sup>2</sup>h (23.5 GFD) for at least 40 minutes.

- Where possible, the filtrate should be discharged before it reaches the filtrate tank to prevent the preservation solution from accumulating in the filtrate tank.
2. In the event that it was not possible to discharge the filtrate before it reached the filtrate tank, empty the filtrate tank completely (including removal of any residue), discharging its contents into the drain, and then clean the filtrate tank if necessary.

## 9.4.2 Rinsing the System

To rinse the system, proceed as follows:


1. Filling the filtrate tank
  - Confirm that no valves are closed on the filtrate side.
  - Run system in filtration mode at a flux rate of approximately 40 l/m<sup>2</sup>h (23.5 GFD) for at least 15 minutes to completely refill the filtrate tank.
2. Performing backwashes
  - Run system in backwash mode for at least 60 seconds (or use up the full volume contained in the filtrate tank).
  - Fill the filtrate tank (see point 1).

### NOTE



Due to the preservation solution, consisting of glycerin and propylenglycol, some COD will still be measurable after this rinsing procedure. If there are specific limits to the amount of COD in the waste water and/or filtered water, then further rinsing might be required. Please contact inge® for further information.

## 10 Disinfecting the System

<b>NOTE</b>	
	<b>ATTENTION!</b> Observe the following requirements!

- The chemical sodium hypochlorite (NaOCl) is used to disinfect the system. This chemical is normally supplied as a chlorine bleaching agent in a stock solution containing a concentration of free chlorine of approx. 12-15 wt%.
- If necessary, the disinfection procedure should be performed multiple times.



## Proceed as follows (for each installed UF rack):

1. Add the calculated volume  $V_{\text{dosage}}$  of a NaOCl stock solution to the filtrate tank, which should already be completely filled with filtrate, in order to obtain a concentration of 20 mg/l of sodium hypochlorite in the filtrate tank (calculations must be tailored to tank volume). Run a backwash for the furthest installed UF rack for at least 30 seconds in order to disinfect the complete filtrate piping. Alternatively, it is also possible to run a CEB with a concentration of 20 mg/l sodium hypochlorite.
2. Run a backwash for at least 30 seconds. Alternatively, it is also possible to run a CEB with a concentration of 20 mg/l of sodium hypochlorite.
3. Open and close all the filtrate sampling valves and all other valves in the filtrate piping/filtrate tank area multiple times.
4. Close all the feed valves.
5. Allow the NaOCl to soak for at least 30 minutes (max. 60 minutes).
6. Periodically check the concentration of sodium hypochlorite (at 5 - 10 minutes intervals). If the level of sodium hypochlorite falls below a value of 5 mg/l, repeat chlorination or add extra doses of fresh stock solution.
7. Run a backwash for at least 60 seconds (Step 7 - 10 applicable for each rack).
8. Run UF rack in filtration mode at a flux rate of 80 l/m<sup>2</sup>h (47 GFD) for at least 10 minutes.
9. Run another backwash for at least 60 seconds.
10. Run UF rack in filtration mode at a flux rate of approximately 80 l/m<sup>2</sup>h (47 GFD) for at least 10 minutes or until the filtrate tank is completely full.
11. After completion of the disinfection for all installed UF racks, empty the filtrate tank completely (remove any residues right down to the deepest section of the tank).
12. Run all available UF racks in filtration mode at a flux rate of approximately 80 l/m<sup>2</sup>h (47 GFD) for at least 10 minutes.
13. Empty the filtrate tank completely (remove any residues right down to the deepest section of the tank).
14. Run all available UF racks in filtration mode with the flux rate and filtration time that is envisioned for the subsequent process (i.e. normal operation).
15. Conclude the previous filtration sequence with a regular backwash. The UF system is now ready for operation. Prepare to verify and potentially adjust the BW process, CEB dosing setpoints and timing as well as the UF feed water coagulation procedure.
16. Perform sampling and analysis to check the bacteriological filtrate quality. If the test results are not satisfactory, repeat the disinfection process. Contact inge GmbH if the number of required disinfection processes exceeds a total of six a year.

## 11 Integrity Testing


### 11.1 General Overview

Integrity testing can be an effective means of checking the intactness of the membrane fibers and the modules. Fully automated integrity testing is typically available for inge<sup>®</sup> modules as a pressure hold test but can be integrated as required by existing process automation software, e.g. in the form of an airflow test or equivalent. Additionally, a semi-automatic bubble test with visual inspection is applicable for individual UF modules.

Integrity testing is based on the phenomenon seen in wetted ultrafiltration membranes whereby water can pass through the pores, but air is prevented from passing through until a certain pressure has been exceeded (the minimum pressure at which air begins to flow is referred to as the "bubble point"). The bubble point pressure depends on the membrane's pore size and on the surface tension at the air-liquid interface. The bubble point pressure of the pores of inge<sup>®</sup> membranes is much higher than the applied test pressure (approx. 1 bar) that is required to detect non-intact fibers.

As a general rule, integrity testing can be performed on both the feed and filtrate sides as considered best applicable for rack and piping design, however, typically the pressurized air is introduced from the UF feed side. When air is used to displace all the water on one of the two sides of the membrane (feed or filtrate side), the pressure on this side will continue to increase since the air cannot pass through the wetted pores (this side is referred to in this context as the "high-pressure side"). Once the test pressure has been reached, all the valves are closed on the high-pressure side. This means that the air can now only escape through defective fibers, through defects in the modules' shell (i.e. through defective gaskets, O-rings or cracks in epoxy sealing) or faulty valves /devices/pipes. A slight pressure drop may be observed due to the natural air diffusion process through the water-filled pores of the membranes. If the pressure differential from the high-pressure side to the low-pressure side is higher than the tolerance limit stipulated by inge GmbH this may indicate a defective fiber or epoxy sealing (or a leakage in the pressurized equipment parts).

If the bubble test is used for individual modules, defects can be detected by air escaping on the low-pressure side due to defects in the fibers or air passage through defects in the modules' shell is visually confirmed by bubbles appearing. In principle, the bubble test can as well be performed in conjunction with fully automated pressure hold tests, provided installation of transparent sight glasses in the filtrate connection piping.

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- Higher test pressures than those recommended by inge GmbH are to be discussed and approved in writing by inge GmbH.
- The air used for air integrity testing must comply with at least the air quality specified in 11.2. Compressed Air Specification.  
Using air with lower quality can cause irreversible fouling and is not permitted.

In dizzer<sup>®</sup> L module installation, pressure hold testing can be carried out automatically, making it easy to confirm fiber integrity on a regular base. Integrity testing is carried out on installed modules (i.e. it is not necessary to remove any of the modules from the pressure vessels). Testing can be performed on filled racks, however, the UF racks are typically (partially) drained prior the integrity testing to reduce duration and thus downtime from integrity testing

## 11.2 Compressed Air Specification

### inge® UF- dizzer® L Series

#### Integrity-Testing & Valve-Cluster

Application	Class* [solid.water.oil]	Pressure [barg] / [psi]
Cabinet / Valve Cluster	1.4.2	6.0 / 90
Integrity test	1.4.1	1.0 / 15

Class	ISO 8573-1 (2010)*					
	solid (particle size and max. concentration [mg/m <sup>3</sup> ])				water	oil
	0.1<d≤0.5µm	0.5<d≤1.0µm	1.0<d≤5.0µm	ppm	max. pressure dew point (DTP)	mg/m <sup>3</sup> / ppm
1	≤ 20 000	≤ 400	≤ 10	0.08	- 70°C / -94°F	0.01 / 0.008
2	≤ 400 000	≤ 6 000	≤ 100	0.8	- 40°C / -40°F	0.1 / 0.8
3		≤ 90 000	≤ 1 000	4.2	- 20°C / -4°F	1 / 0.83
4			≤ 10 000	6.7	+3°C / +37°F	5 / 4.2
5			≤ 100 000	8.3	+7°C / +45°F	25 / 21

\* according to ISO 8573-1: 2010

Classification of purity for the particles, water and oil

Total air flow rate** @ 1bar	=	[ Hold-up volume Module Rack***	+	Hold-up volume connecting pipework****	]	/	Time (recommended)
dizzer® L Series	=	[ feed side	+	Feed header / manifold	]	/	10 minutes

\*\* For compressor sizing

\*\*\* Find hold-up volume in the inge® product data sheet

\*\*\*\* To be calculated

## 11.3 Testing Frequency

Both integrity tests (pressure hold and bubble test) should be performed at the end of the commissioning phase, after maintenance work, and in the event of any suspicion that the membrane system may be malfunctioning (e.g. increased bacteria counts on the filtrate side). Integrity testing can also be regularly carried out on an automated basis and seamlessly integrated in standard filtration operations.

## 11.4 How to Perform a Pressure Hold Test

A pressure hold test is carried out for each rack in turn, i.e. the modules of a single rack are tested in parallel. The following figure (see Figure 11.4-1) shows an example using the feed side as the high-pressure side.

1. Dewater the respective high-pressure side (feed side dizzer® L modules series) and build up the pressure: Optionally, initially (partially or fully) drain the feed side of the UF racks to minimize time requirement for the dewatering phase. Open all feed drain and vent valves for this step. Next, fill the entire high-pressure side with dry, oil-free compressed air at a pressure of 1 bar (14.5 psi). The low pressure side of the modules must be left open to drain towards atmospheric pressure. The applied air pressure forces the water through the membrane from the high-pressure side to the low-pressure side (dewatering phase). In principal, air cannot pass integral membranes due to the surface tension of the water in the membrane pores (diffusion processes not considered). The duration of emptying a rack depends on total rack size and volume of connected pipework and compressor capacity. Without the initial gravity drain, the dewatering phase typically takes between 10 and 30 minutes to complete but will depend on project specifics.
2. Once the high-pressure side has been completely emptied of water and a stable pressure of 1 bar (14.5 psi) has been reached (and maintained for at least 1 minute), close the air supply to the high-pressure side (see Figure 11.4-2).

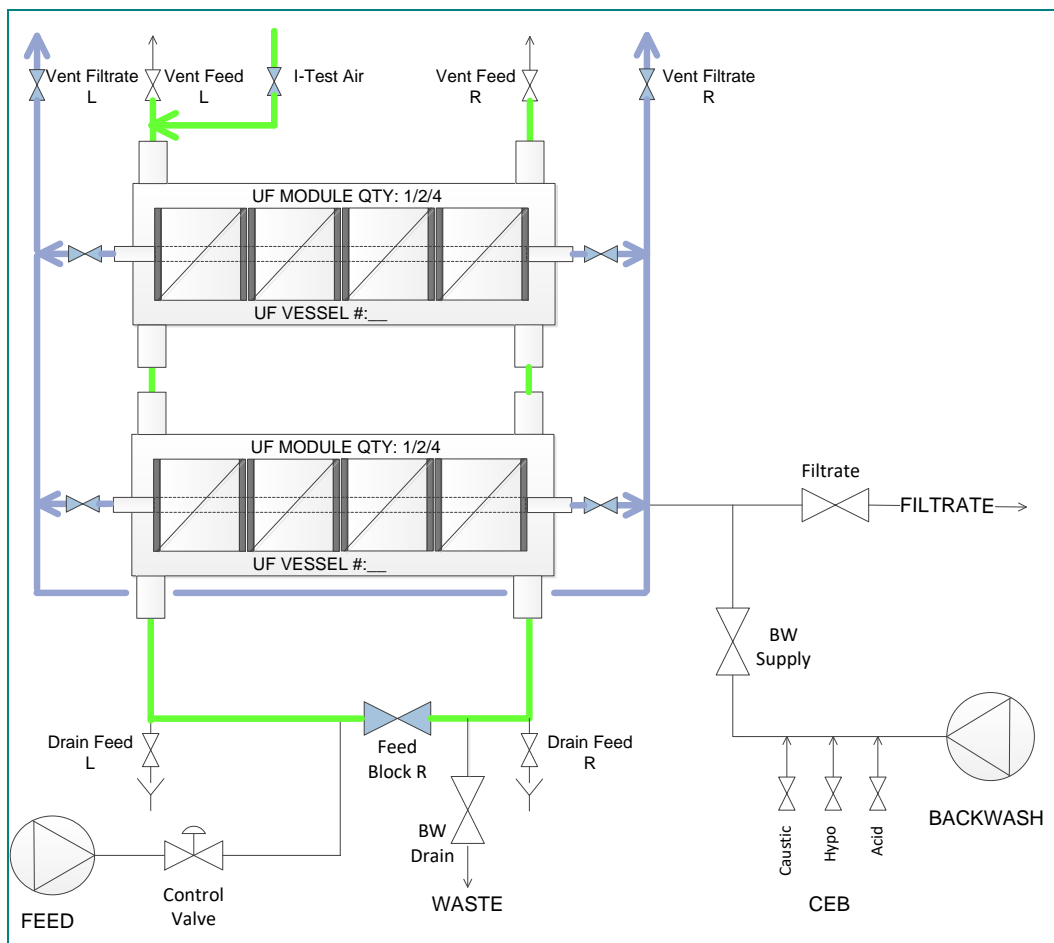


Figure 11.4-1 - Dewatering phase for integrity test from feed side – exemplary configuration

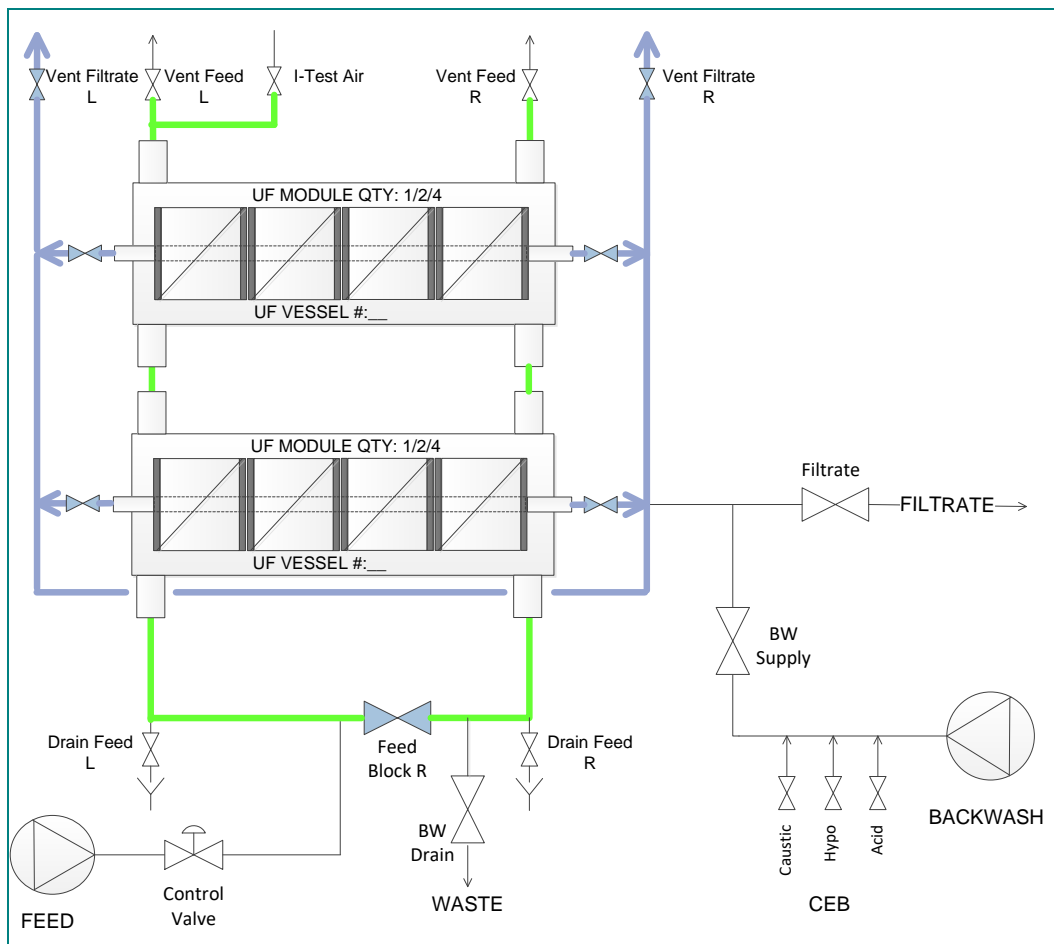


Figure 11.4-2 - Pressure hold phase and pressure measurement for integrity test from feed side – exemplary configuration

3. Measure the pressure drop:
 

Measure the pressure drop on the high-pressure side for at least 3 minutes or as directed by existing process automation software. Due to the air diffusion process through the water-filled pores of the membranes, a slight pressure drop may be observed. This should be taken as a base value and should not be regarded as a membrane leakage due to defective fibers. The base value is dictated by various factors, including the hold-up volume, the tightness of all valves and fittings and the diffusion component of the modules. In the event that the base value is exceeded, we recommend conducting a detailed examination to establish the cause.

## NOTE



### ATTENTION!

Observe the following requirements!

- Determination of the base value must be performed using new modules (during system commissioning) in the fully assembled rack. This base value then serves as a reference value. At a test pressure of 1 bar (14.5 psi), this value is expected to be lower than 10 mbar/min for all rack sizes.
  - It is important to ensure that the low-pressure side is open, unpressurized and completely filled with water when measuring this value.
  - Repeat test with individual pressure vessels if required (optional pressure vessel isolation valves)
4. Bubble test (optional, requires installation of sight glasses):  
 Any leakage in the individual modules of each pressure vessel can be detected on the low-pressure side using an optional segment of transparent sight glass or pipe. In the event of a leak, a continuous stream of air bubbles of a steady intensity will be visible during the integrity test.  
 If a significant, uniform stream of air bubbles is visible in the transparent pipe, and if the pressure drop is greater than the base value, it can be assumed that at least one of the modules inside the respective pressure vessel has a defective fiber or existence of a defect in any of the modules' shells, assuming that all other sources of error have been ruled out during the integrity test. Please note that the initial gravity drain step must be skipped if the bubble test is used.



*Figure 11.4-3 – Optional sight glass connected to the filtrate ports on both sides of the pressure vessels for visual observation during integrity test (bubble test) – exemplary configuration*

5. Pressure relief:  
 After performing the pressure hold test, the pressure is released on the high-pressure side. For feed-side tests, this is achieved by opening a valve on the feed/rinse water side (see Figure 11.4-4).
6. Other integrity testing methods:  
 Depending on existing third party SCADA automation, other types of integrity tests, such as the airflow test, may be used in addition or replacement of the pressure hold test. No further detail information for third party testing procedures can be provided in this manual.

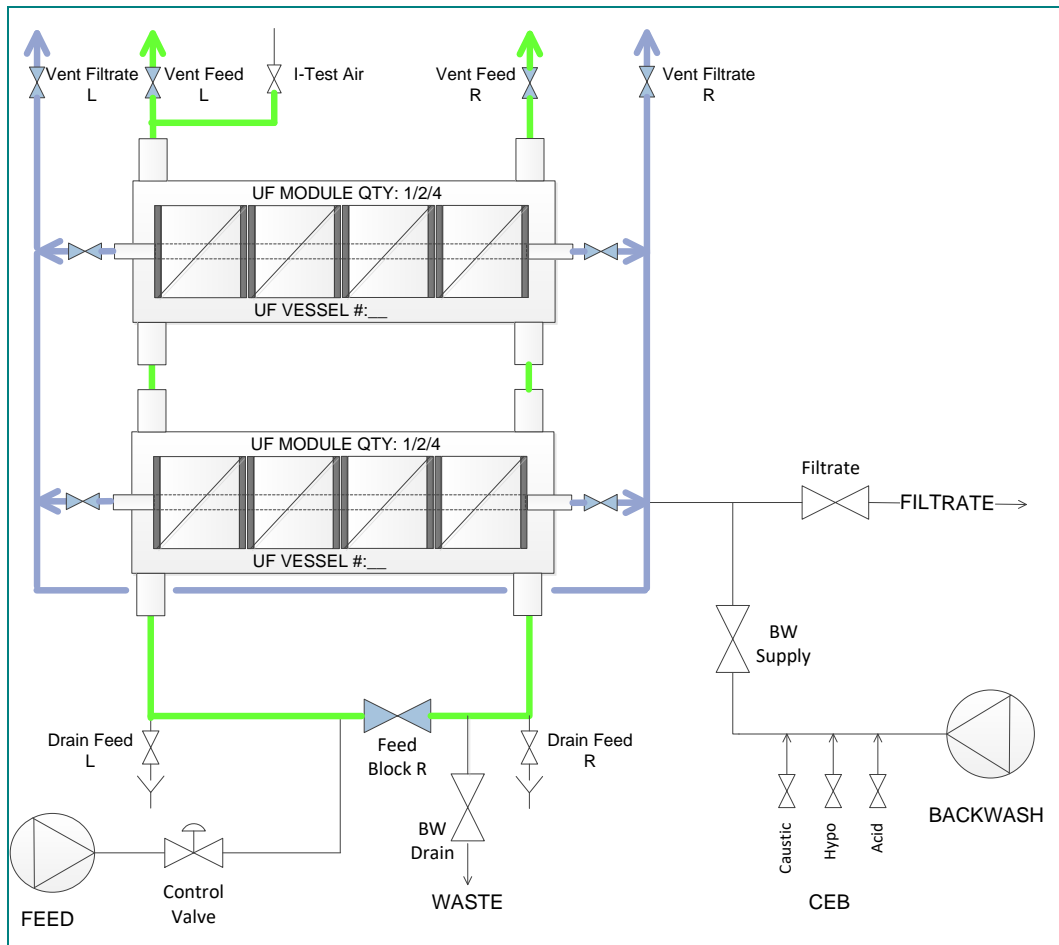



Figure 11.4-4 - Process Flow I-Test Pressure Relief – exemplary configuration

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- Make sure to carefully control the pressure release, among other reasons to prevent any water/air hammers and any risk to people who may be in the surrounding area.

7. Venting the system:

After completing the integrity test, the rack/system must be vented.


For venting procedure, please refer to chapter 9.4.1.

Regular filtration operation can then resume, starting with a filtration step. During the first approx. 5 - 10 minutes, filtration should be performed at a reduced flux rate of approximately 40 l/m<sup>2</sup>h (23.5 GFD) to ensure the system is completely vented.

## 12 Further Functionality requirements on Operating inge® dizzer® L Series Modules

### 12.1 Avoiding Membrane-Damaging Particles and Substances

inge® Multibore® membrane fibers are extraordinarily resistant to chemical, mechanical and thermal damage. Nevertheless, incorrect or improper operation of inge® membranes could still potentially cause damage to the membrane material, membrane resin or membrane fibers.

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>


- Any treatment of waters with concentrations of dissolved substances in excess of 7 wt% is a special application which is not covered by the standard terms of the inge GmbH warranty policy. We therefore recommend performing pilot testing before building a membrane facility to treat waters of this kind.
- inge GmbH's warranty policy does not cover modules and membranes that are irreversibly destroyed by particles, substances or foreign objects that are produced within the module/rack or washed into the module/rack by feed water, backwash water, CEB/CIP water or compressed air (for example during integrity testing) due to a failure to comply with inge®'s specific product documentation (including installation manuals and process requirements).
- In particular, the modules' conditions of use prohibit any of the following substances from being introduced into the module(s)/rack(s) on either the filtrate or feed side:
  - Particles and foreign objects > 300 µm.
  - Abrasive, sharp-edged particles that can cause irreversible damage to the membrane surface.
  - Corrosion or erosion products produced in the water treatment plant and washed into the module (e.g. sand or concrete residue from the backwash tank).
  - Foreign objects introduced during installation and maintenance such as metal or plastic shavings.
  - Precipitated material washed into the module during operation (e.g. during a CEB or CIP) or precipitation that forms within the module which has not been properly removed from the module in accordance with this document.
  - Polar, organic or chlorinated solvents.
  - Concentrated acids with a pH < 1 or caustics with a pH > 13.
  - Ozone or any other hydroxyl-radical-producing oxidizing agents from advanced oxidation processes (AOPs) such as UV + H<sub>2</sub>O<sub>2</sub>, UV + TiO<sub>2</sub> or Fenton-like reactions such as H<sub>2</sub>O<sub>2</sub> + Fe(II), Cu(II), Ti(III), Cr(II) or Co(II).



## 12.2 Preventing Chemically Irreversible Fouling


Thanks to their high level of chemical resistance, Multibore® membranes and modules can be cleaned using a range of chemicals in high concentrations. The standard inge® CIP is capable of removing practically all natural water constituents which cannot be removed by regular CEBs and which accumulate in or on the membrane over the course of time.

Nevertheless, failure to operate inge® membranes in accordance with the functionality requirements or the presence of non-membrane-compatible substances in the feed water, backwash water, CEB/CIP water or compressed air could potentially lead to cases of irreversible fouling/scaling which can no longer be removed at a reasonable cost even with the most intensive CIP. Substances of this kind can be found, for example, in blow-down waters from cooling tower water treatment processes, in industrial process waste waters and in surface waters containing a significant proportion of waste water. We therefore urgently recommend performing pilot testing before building a membrane facility to treat waters of this kind.

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- inge GmbH's warranty policy does not cover modules and membranes that are irreversibly contaminated – to an extent that cannot be successfully rectified even by intensive chemical cleaning – by particles, substances or foreign objects that are produced within the module or washed into the module by feed water, backwash water, CEB/CIP water or compressed air due to a failure to properly comply with inge®'s specific product documentation (including installation manual and process requirements).
- In particular, the modules' conditions of use prohibit any of the following substances from being introduced into the modules/racks on either the filtrate or feed side:
- Organic polymers that are not naturally present in the water being treated. These polymers may not be added to the system either directly upstream from the membrane/module(s)/rack(s) or at any other point in the overall process. These include, for example:
  - Organic coagulants and coagulation aids
  - Organic corrosion inhibitors
  - Organic dispersants
  - Organic wetting agents.
- In exceptional cases, the substances listed above may be used or may be present in low concentrations in the water being treated if it has been proven that they do not cause any chemically irreversible fouling. However, this requires prior written approval by inge GmbH.

## 12.3 Permitted Conditions of Operation, Rinsing, Cleaning and Disinfection

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- All inge® modules/casings/racks must be operated and used in accordance with the following operating conditions. Proper compliance with the permitted operating conditions is a prerequisite for making a claim under the warranty.

	<b>Maximum system pressure</b>	<b>Maximum rate of pressure change</b>
dizzer® L	Depending on existing pressure vessel & piping specification	0,5 bar/s

	<b>Transmembrane Pressure (TMP)</b>
Filtration:	max. 1.5 bar
Backwash:	max. 3.0 bar
Integrity test:	max. 1.0 bar air pressure

The permissible transmembrane pressures are not calculated on the basis of membrane strength. Instead, they are designed to ensure stable long-term operation. The burst pressure of the Multibore® membrane is in excess of 10 bar.

## Permitted Chemicals

Chemicals may only be used in accordance with inge®'s specific product documentation (including installation manuals and process requirements).


Permissible pH range during operation:	pH 3 – 10
Permissible pH range for cleaning:	pH 1 – 13
Maximum concentration of hydrogen peroxide (H <sub>2</sub> O <sub>2</sub> ):	500 mg/L

The use of sodium hypochlorite is only permitted for the following applications in the maximum concentrations indicated below:

Maximum concentration	For CIP	500 mg/L at pH ≥ 9.5
	For CEB	200 mg/L at pH ≥ 9.5
	At the membrane during continuous dosing	0.2 mg/L
	During shock chlorination at pretreatment stage	10 mg/L for 30 minutes, max. once a day
	Membrane disinfection CEB in waste water applications	10 mg/l for 30 minutes, max. once a week or daily in the event of system shutdown > 24 h < 7 d
	During system disinfection	20 mg/L for 60 minutes, max. 6 times a year
Maximum continuous concentration	In swimming pool applications	0.7 mg/L

## Permissible Temperature Ranges


Maximum temperature range	1 °C - 40 °C
Maximum rate of temperature change	< 5 °C/ min

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>


- Please note that operating the membranes/module(s) with a simultaneous combination of the maximum limits for temperature, pH, effective chemical concentration and/or pressure during all operating modes will have an impact on the membranes' service life.

## 13 System Shutdowns

Please observe the following functionality requirements for different downtime conditions and durations.


<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- Membranes/module(s) that have been used must be kept wet at all times.
- To avoid microbial growth during plant shutdowns or storage of decommissioned modules, wet membranes must be rinsed with a suitable disinfectant solution and properly preserved.
- Rinsing prior to a downtime of up to 24 hours.  
Before a downtime lasting less than 24 hours, a backwash of at least 60 seconds must be performed. No further action is required.
- Rinsing and disinfection for downtimes > 24 hours.  
For shutdowns > 24 hours, a chlorinated backwash is required prior to shutdown. To do so, hypochlorite must be dosed together with caustic soda during backwash to achieve a concentration of 2 - 3 ppm free chlorine, while operating the caustic soda pump to achieve a pH of 9.0 - 9.5.  
  
UF racks must be checked daily (feed and filtrate sampling ports) to ensure a residual of a minimum of 0.1 ppm free chlorine. Otherwise the process must be repeated.
- Preserving modules for downtimes > 7 days.  
Membranes/module(s) must be properly preserved in the event of a system shutdown lasting longer than 7 days. Before taking steps to preserve the membranes/module(s), it is absolutely essential to perform chemical cleaning to remove any organic or inorganic contaminants (fouling, scaling) from the membranes. Please contact inge<sup>®</sup> for instructions on the preservation method for the dizzer<sup>®</sup> modules.

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- Whichever of the above situations applies, the membranes/module(s) should be kept hydraulically filled with liquid. The membranes must be kept free of any oxidizing agents during system shutdowns.
- If you wish to use any other disinfectants, please contact inge GmbH beforehand. It is essential to obtain prior written agreement and approval from inge GmbH regarding the chemicals and concentrations that are permitted for use.
- To put the system/module(s)/rack(s) back into operation, it is essential to follow the requirements for system commissioning.

## 14 Documentation of Operating Conditions

<b>NOTE</b>	
	<p><b>ATTENTION!</b></p> <p>Observe the following requirements!</p>

- From the moment the module(s)/rack(s) are first put into operation, the operator is obliged to maintain complete and continuous documentation of the operating parameters and the amount of time the plant has been operated in each of the various operating modes.
- No warranties or warranty claims shall be valid without this documentation.
- The feed water quality must be measured after every chemical dosing procedure and after the prefiltration stage in front of the UF. The results of the analyses must be documented.

### The following UF system parameters must be recorded and documented:

1. pH value, temperature and turbidity<sup>4</sup> in the feed immediately prior to ultrafiltration (UF).
2. Permeability (@ 20°C), volume flow rate, transmembrane pressure (TMP) and absolute pressure (feed/filtrate) per rack / per filtration line during filtration/backwash, CEB/CIP and integrity testing; realized as a delta p measurement transmitter or with individual transmitters, positioned close to the module(s).

Data shall be automatically collected and logged at least every 2 seconds during backwash and CEB (injection and rinsing) and at least every 3 minutes during filtration and CEB soaking to ensure that all effects of changes in pump operation and/or valve positions (changing modes and procedures) are recorded.

3. Chemicals
  - Use of chemicals for pretreatment, measured directly in the feed prior to UF:
    - Type and concentration of coagulants
    - Type and concentration of oxidants.
  - Use of chemicals for CEB/CIP, measured within the rack(s) (chemicals in contact with the membranes/module(s)):
    - Type, contact time and concentration of oxidants or other membrane cleaning agents
    - Type, contact time and pH value of acids/bases.

The minimum interval for one complete set of measurements (lab or on-line measurements) is one per day or one measurement per CEB/CIP.

In the event of a module defect, it is necessary to provide documentation on the position of the defective module within the rack(s) (line, train/unit, side, position) together with details of the module(s) serial number.

---

<sup>4</sup> White light turbidity meters are impacted by dissolved organic molecules while infrared devices are impacted by particles only; therefore, infrared or laser devices are recommended to monitor the UF filtrate turbidity. In addition, glass cuvettes should be replaced on a frequent basis to prevent interferences by scratches.

## 15 Technical Documentation

### 15.1 Other Applicable Documents

- dizzer<sup>®</sup> L Series – Assembly Instructions

## How to Contact us

Please contact inge GmbH if you require any further information:

**inge GmbH**  
Flurstraße 27  
86926 Greifenberg  
Germany

Tel: +49 8192 997-700  
Fax: +49 8192 997 999  
E-Mail: [inge@dupont.com](mailto:inge@dupont.com)

<https://www.dupont.com/brands/inge.html>

inge GmbH  
Flurstrasse 27  
86926 Greifenberg  
Germany  
Phone: +49 8192 997-700  
Fax: +49 8192 997-999  
Email: [inge@dupont.com](mailto:inge@dupont.com)

<https://www.dupont.com/brands/inge.html>

#### Note

The descriptions, designs, data and product information contained herein are presented in good faith and are based on inge GmbH's current knowledge and experience. inge GmbH cannot accept any liability for the accuracy of this product information, which is provided at no charge and for guidance only.

inge® products are designed to be operated in accordance with the corresponding inge® product documentation. The product information and products are protected by copyright and/or other intellectual property laws worldwide. However, inge GmbH cannot guarantee that the product information and products can be used without infringing third party intellectual property rights. The products and product information may only be used, distributed and marketed with the express prior permission of inge GmbH.

No warranties of any kind regarding the products, either expressed or implied, including, but not limited to, warranties of merchantability, fitness for a particular purpose or no third party rights are made, other than as expressly set out in the contractual agreement with the customer. Mechanical stability and full functionality of inge® products can only be provided by genuine inge® parts.

inge GmbH reserves the right to modify products and product information at any time without prior information. Current product information can be obtained from the website <https://www.dupont.com/brands/inge.html>.

DuPont™, the DuPont Oval Logo, and all trademarks and service marks denoted with ™, ™ or © are owned by affiliates of DuPont de Nemours, Inc. unless otherwise noted. © 2021 DuPont



a DuPont brand